

Environmental Surveillance Report

For the
U.S. Department of Energy

Rocky Flats Environmental Technology Site

Information Exchange

FIRST QUARTER 2001



**Colorado Department
of Public Health
and Environment**

This is a summary of environmental surveillance monitoring performed by the Colorado Department of Public Health and Environment during the past calendar quarter. Data for earlier periods that have not already been reported may also be included.

Revised 6/11/01

If you have questions or comments about this report, or if you would like to be placed on the mailing list to receive copies of this report in the future, please write to:

Rocky Flats Program,
Hazardous Material and Waste Management Division
Colorado Department of Public Health and Environment
4300 Cherry Creek Drive South Denver, Colorado 80246-1530
Telephone (303) 692-3300

or

Rocky Flats Program
Laboratory and Radiation Services Division
Colorado Department of Public Health and Environment
8100 Lowry Boulevard
Denver, Colorado 80220
Telephone (303) 692-3090

INTERNET ACCESS

Air Pollution Control Division

Email arch.crouse@state.co.us
World Wide Web www.cdphe.state.co.us/ap/

Email gordon.pierce@state.co.us
World Wide Web www.cdphe.state.co.us/ap/

Hazardous Materials & Waste Management Division

Email rich.horstmann@state.co.us
World Wide Web www.cdphe.state.co.us/hm/

Email deb.shaw@state.co.us
World Wide Web www.cdphe.state.co.us/hm/

Laboratory and Radiation Services Division

Email tony.harrison@state.co.us
World Wide Web www.cdphe.state.co.us/lr/

TABLE OF CONTENTS

INTRODUCTION	1
2000 Air Monitoring Stations	2
2000 Surface Water Sampling Locations	3
DECISION RULES	4
ANALYTES OF INTEREST	7
AIR and WATER STANDARDS	
National Ambient Air Quality Standards	10
Colorado Water Quality Control Commission Standards for Radioactive Materials at and around RFETS	11
Sampling and Analytical Results for this Quarter	
AIR RESULTS	
Description of Air Sampling this Quarter	14
Graphs of Selected Air Results	15
Tabular Data	
Table A Gross Alpha and Gross Beta Radioactivity in Airborne Particulate Material	A1
Table B Alpha Spectrometric Analysis and Long-Lived Gross Alpha Radioactivity Concentrations in Suspended Airborne Particulate Material	B1
Table D Inorganic Gaseous Compounds in Air	D1
Table E Suspended Particulate Material in Air	E1
Table F Metals in Air	F1
Table G Volatile Organic Compounds in Air	G1
WATER RESULTS	
Description of Precipitation and Surface Water Sampling Done This Quarter	22
Precipitation	22

Surface Water	22
Notable Surface Water Results	22
Graphs of Selected Water Results	23
Tabular Data	
Table H Inorganic Analysis of Surface Water	H1
Table I Organic Analysis of Surface Water	I1

GLOSSARY	28
----------	----

Introduction



The purpose of this Environmental Surveillance Report (ESR) is to provide a quarterly update on Colorado Department of Public Health and Environment (CDPHE) air and surface water monitoring data at the Rocky Flats Environmental Technology Site (RFETS).

CDPHE currently has three Divisions that conduct monitoring at RFETS including the Air Pollution Control Division (APCD), the Hazardous Materials Waste Management Division, and the Laboratory and Radiation Services Division (LARS). APCD monitors air for contaminants such as particulates, oxides of nitrogen, ozone, volatile organic compounds (VOCs), radionuclides and beryllium. The Hazardous Materials Waste Management Division conducts surface water monitoring for many parameters, including metals, inorganics and radionuclides. The Radiation Control Division performs radiological monitoring in air and precipitation.

Under normal conditions, groundwater and soils are not monitored by Colorado Department of Public Health and Environment (CDPHE), but are monitored by DOE.

Sampling and data analysis is performed by CDPHE according to the Rocky Flats Integrated Monitoring Plan (IMP), which describes not only the monitoring done by CDPHE, but also that done by the Site and surrounding communities. It is possible that CDPHE may do some additional sampling as part of a special study or for some unusual circumstances. This report describes the results of both types of CDPHE monitoring.


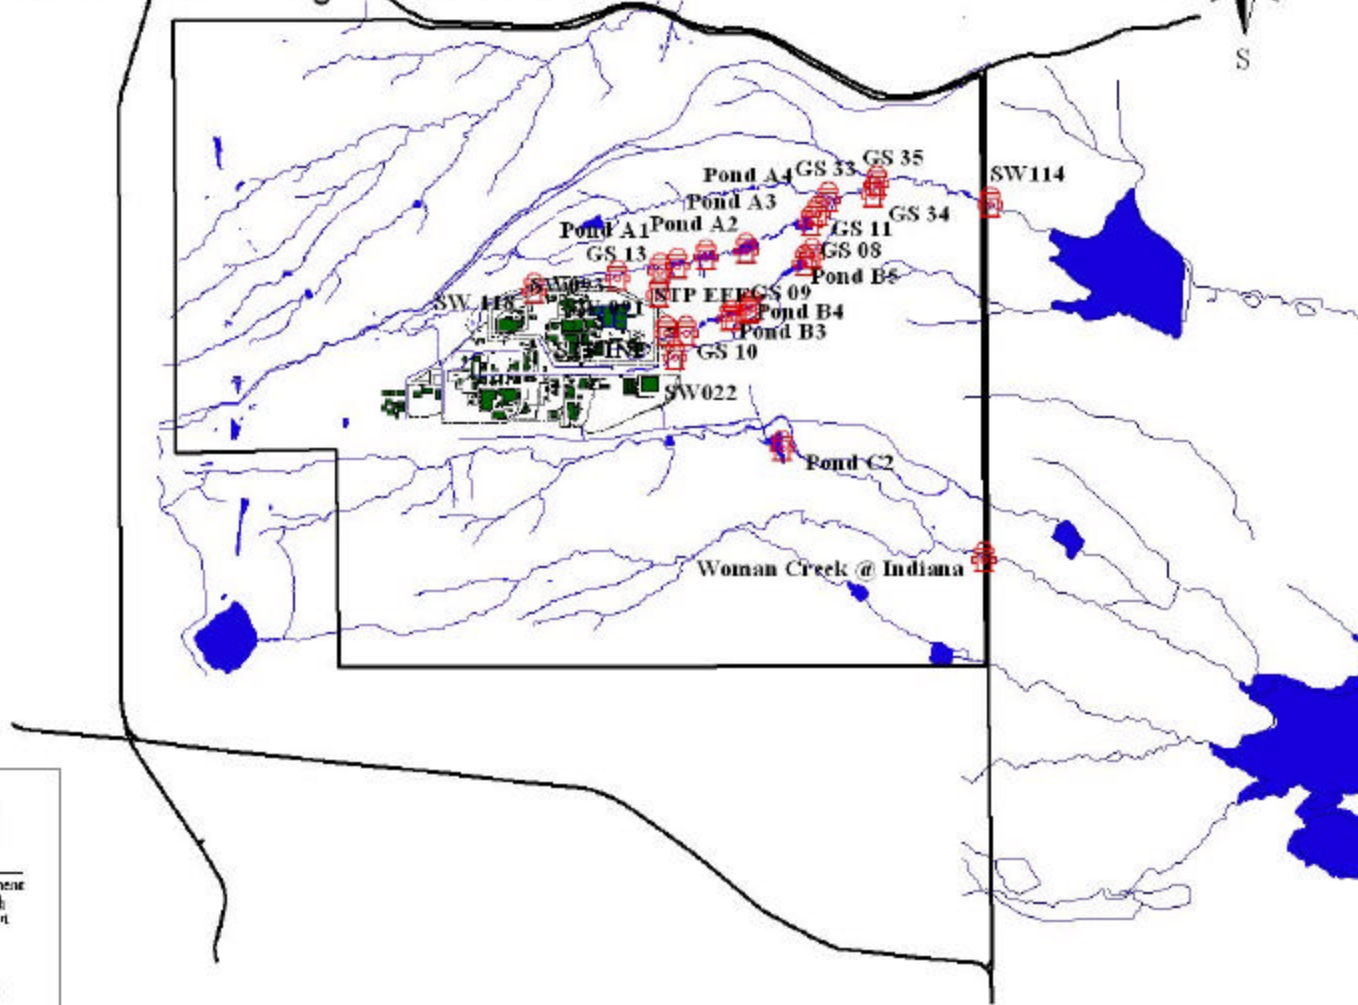
Colorado Department of Public Health and Environment
Air Monitoring Locations 2000

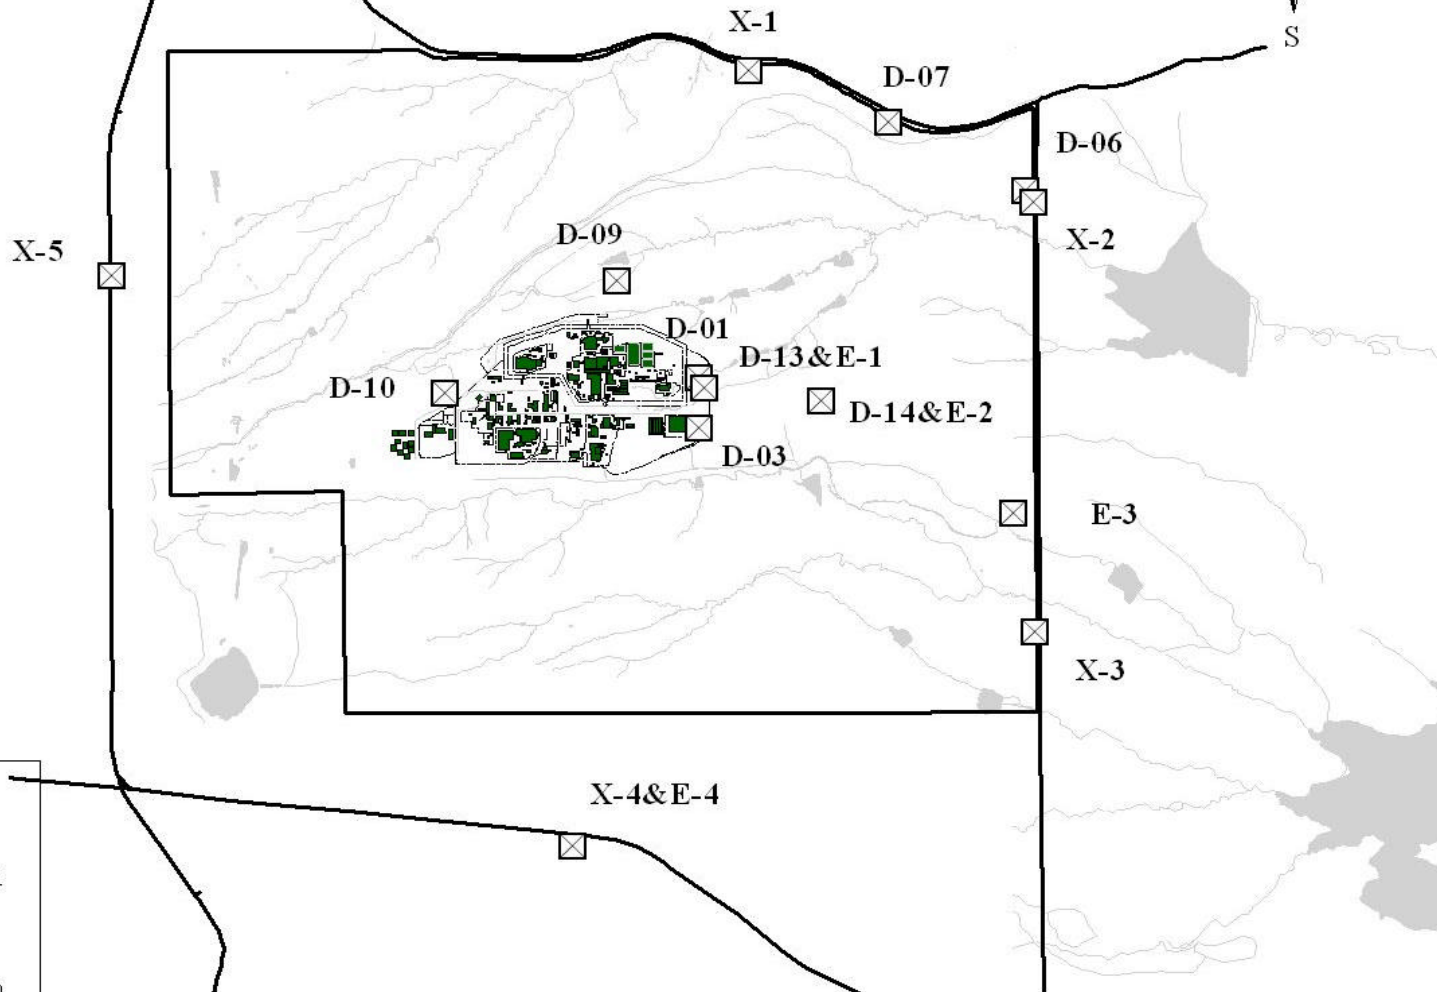

2000 Air Monitoring Stations

Colorado Department of Public Health and Environment

Surface Water Monitoring Locations 2000



Colorado Department
of Public Health
and Environment

JWL:ave
May 11, 2000

2000 Water Monitoring Stations

Decision Rules

The data acquired for each quarter is examined using standard methods of evaluation that are described in the Integrated Monitoring Plan (IMP). The methods use a series of decision rules to effectively analyze the data that has been collected, and make determinations about what actions need to be taken. Decision rules are if-then statements pertaining to data quality objectives. The decision rules define, quantitatively and qualitatively, the point at which a decision should be made or action should be taken.

The decisions could involve many different actions including, but not limited to, further analysis of data, implementation of new monitoring stations for source detection, management decisions, or evaluation of remediation alternatives. Any exceedence of an action level for a surface water or air contaminant during the quarter are summarized in this report, along with any actions taken or follow up investigations that are required.

The primary decision rules that pertain to each media are outlined below:

A. Air Monitoring

1. **Ambient Air Quality Monitoring:** Nitrogen Dioxide (NO₂), Ozone (O₃) and particulate monitoring is performed by APCD. Particulate monitoring includes monitoring of both fine particulates (PM₁₀) and total suspended solids (TSP).

IF: A perimeter monitor detects an NO₂ (annual arithmetic mean) concentration of 0.053 parts per million (ppm), an O₃ (1 hr av. time) concentration of 0.12 ppm, a TSP measurement of 75 µg/m³ averaged over a 1 year time period or 150 µg/m³ over a 24-hour time period, or a PM₁₀ concentration of 50 µg/m³ annually or 150 µg/m³ in a 24-hour period (Include these values in a table in the report, too confusing this way)

THEN: The Site's operating permit may potentially be revised to mitigate the exceedence.

2. **Beryllium (Be) Monitoring:** Emission points (stacks) are monitored for Be.

IF: Be emissions from a source exceed 10 g in a 24-hour period

THEN: CDPHE may take enforcement action.

IF: Ambient Be concentrations at monitoring sites exceed 0.01 $\mu\text{g}/\text{m}^3$ over a 30-day Period
THEN: CDPHE may take action to identify the source.

3. Volatile Organic Compound (VOCs) Monitoring: Various VOC monitoring stations exist around the perimeter of the site and are maintained by APCD. It is possible that remediation processes could release significant levels of VOCs. VOC data does not tend to vary and the measured concentrations are generally very low. A significant increase from normal levels of any VOC at any monitoring site could indicate a potential problem.

IF: A measured value of any VOC exceeds trends in historical data
THEN: An investigation will be enacted to determine the source of the elevated VOC concentration.

4. Radiological Ambient Air Quality Monitoring: Laboratory and Radiation Services Division (LARS) and Air Pollution Control Division (APCD) air sampling locations are monitored for radiological contaminants, PM_{10} and total suspended particulates (TSP).

IF: Measured values of radionuclides exceed typical trends existing in historical data
THEN: Any number of actions may be taken including, but not limited to, analysis of samples for verification, comparison of samples from nearest DOE monitoring sites, ComRad Program samplers, and/or APCD monitoring sites, request for investigation or explanation of elevated results from DOE, calculation of public dose/risk and/or a presentation to CDPHE management.

B. Surface Water Monitoring

1. Source Location: Current surface water monitoring sites monitor for Analytes of Interest (AoIs) and indicator parameters for AoIs. Contaminant levels that exceed historical trends at a certain site could indicate the presence of a new contaminant source. When a new contaminant source is identified by a current monitoring location, it may be necessary to implement additional monitoring sites to identify the exact location of the new source.

IF: A new contaminant source is identified by any monitoring station
THEN: Action should be taken to locate and quantify the source. Mitigation action will be taken pursuant to the Rocky Flats Cleanup Agreement (RFCA) Action Level Framework (ALF).

2. Wastewater Treatment Plant (WWTP) Influent Radiological Monitoring: The Site has made an effort to eliminate any possible connections between waste streams containing radionuclides and WWTP influent. Therefore, it is assumed that radiologic loads will not significantly increase from baseline values. Radiologic parameters include total plutonium, total americium, total uranium, tritium, as well as alpha and beta activity. Decontamination and decommissioning (D&D) activities could potentially introduce radiologic loads to WWTP influent. The influent is monitored to track sources of contaminants that may be introduced during the cleanup process.

IF: Influent loading for any of the radiologic parameters exceeds baseline values determined from historical data
THEN: Evaluation will be performed to determine the source of contamination.

3. Pond Predischarge Monitoring: AoIs and some volatile organic compounds (VOCs) are monitored in the ponds previous to pond discharge so that discharge will not result in exceedence of stream standards.

IF: Predischarge monitoring shows exceedence of stream standards

THEN: CDPHE will notify the Site. At this point the Site may evaluate alternative options which avoid immediate discharge including, but not limited to, treatment, storage or disposal.

4. Precipitation Sampling: LARS is involved with sampling precipitation for gross alpha/beta, Pu-239/240, Am-241 and Tritium.

IF: Any measurement of radionuclides in precipitation exceeds the normal variation occurring in historical and baseline measurements

THEN: A series of actions may be taken including, but not limited to, reanalysis of the samples, analysis of individual ambient air filters from the same quarter, request for analysis of nearby filters from DOE, ComRad, or APCD sample sites, request for investigation, request for CDPHE and DOE modeling to determine environmental effects.

Analytes of Interest

Analytes		Air	Water	Purpose of Monitoring
Radionuclide:	Pu	X	X	High level of public concern. Known carcinogen. Known past releases (within the past 8 years) have exceeded RFCA stream standards and action levels. This provides reasonable cause to expect future releases in excess of RFCA Action Levels.
	U	X	X	Known renal toxicity. Past exceedances provide reasonable cause to expect future releases in excess of RFCA stream standards and action levels.
	Am	X	X	Known carcinogen. Known past exceedances provide reasonable cause to expect future releases in excess of RFCA stream standards and action levels.
	Tritium		X	Is an AOI due to past releases to drinking water supplies
Metals:	Be	X	X	Known to cause berylliosis in susceptible individuals when exposed in inhalation. May also cause contact dermatitis. Will be monitored as an indicator of releases from process and waste storage areas.
	Cr		X	Physiological and dermal toxicity. High level of regulatory concern due, in part to the chromic acid of incident of 1989. Low levels can cause significant ecological damage.
	Ag		X	Highly toxic to fish at low levels, if chronic. State of Colorado has temporarily removed its stream standard for silver, while under study. The study has been completed, and the standard will be reinstated at the next triennial review of South Platte stream standards, if not before. Used at RFETS only for photographic development. Routinely accepted by POTWs as municipal waste, but discharge is regulated. May be removed from this list later if data do not support concern.
	Cd		X	Highly toxic to fish at low levels, if chronic. Known human carcinogen (prostate cancer) and depletes physiologic calcium. Used at RFETS in plating processes. Monitoring data for the Interceptor Trench System (ITS) and the proposed discharge of untreated ITS waters into Walnut Creek provide reasonable cause to expect future releases in excess of RFCA Action Levels
	Hardness		X	Required to evaluate metals analyses, due to its effect on solubility to these metals.
Particulates:	Total suspended particulates	X		Monitored to provide information on total airborne particulate levels. Filters also used for metals and radionuclides analyses.

	PM ₁₀ particulates	X		Monitored to provide information on fine airborne particulate levels. Filters also used for metals and radionuclides analyses.
Volatile Organic Compounds:	VOCs	X	X	A variety of volatile organic compounds, some of which are toxic to humans and ecology. Known discharges to air and water as well as groundwater infiltration.
Real Time Monitoring of Physical and Indicator Parameters: (These parameters provide real-time indication for a wide variety of regulated contaminants, and are also required component for monitoring for AoIs. They require no laboratory analysis and are the RFETS most cost effective defensive monitoring.)	pH		X	Toxicity to humans and ecology. Regulatory concern due to chromic acid incident. Real-time monitoring is an inexpensive and effective method of detecting acid spills such as (chromic acid or plutonium nitrate) or failure of treatment systems.
	Conductivity		X	Conductivity is an indicator of total dissolved solids, metals, anions, and pH. Real-time monitoring of conductivity is an inexpensive indicator of overall water quality.
	Turbidity		X	Turbidity is a general indicator of elevated contaminant levels, and may be correlated with Pu.
	NO ₃		X	Past releases near RFCA stream standards and action levels upstream of ponds provide reasonable cause to expect future releases in excess of RFCA stream standards and action levels. ITS discharges are often high in nitrate, and may challenge RFCA action levels.
	Flow		X	Required to detect flow events, evaluate contaminant loads and plan pond operations and discharges. Affects nearly every decision rule, and is the most commonly discussed attribute of RFETS surface waters.
	Oxides of Nitrogen	X		Monitored due to RFETS historical use of nitric acid.
	Ozone	X		Monitored as part of the CDPHE network. Not required or part of monitoring for RFETS.
	Wind speed	X		Monitored to provide emergency response modeling information.
	Wind direction	X		Monitored to provide emergency response modeling information.
Temperature	X		Monitored to provide emergency response modeling information.	

NATIONAL AMBIENT AIR QUALITY STANDARDS

POLLUTANT	AVERAGING TIME	STANDARD
Carbon Monoxide (CO)		
Primary Standard	1 Hour ^(a)	35 ppm
Primary Standard	8 Hour ^(a)	9 ppm
Ozone (O ₃)		
Primary and Secondary Standards (up to 1997)	1 Hour ^(b)	0.12 ppm
Primary and Secondary Standards (as of July 1997)	8 Hour ^(c)	0.08 ppm
Nitrogen Dioxide (NO ₂)		
Primary and Secondary Standards	Annual Arithmetic Mean	0.053 ppm
Sulfur Dioxide (SO ₂)		
Primary Standard	Annual Arithmetic Mean	0.030 ppm
Primary Standard	24 Hour ^(a)	0.14 ppm
Secondary Standard	3 Hour ^(a)	0.5 ppm
Particulates (PM ₁₀)		
Primary and Secondary Standards	Annual Arithmetic Mean ^(d)	50 µg/m ³
Primary and Secondary Standards	24 Hour ^(b) prior to July 1997, ^(e) as of July	150 µg/m ³
Fine Particulates (PM _{2.5}) (as of July 1997)		
Primary and Secondary Standards	Annual Arithmetic Mean ^(d)	15.0 µg/m ³
Primary and Secondary Standards	24 Hour ^(f)	65 µg/m ³
Lead (Pb)		
Primary and Secondary Standards	Calendar Quarter Average	1.5 µg/m ³
Total Suspended Particulates (TSP)		
Primary Standard	Annual Geometric Mean ^(g)	75 µg/m ³
Primary Standard	24 Hour ^(g)	260 µg/m ³
Secondary Standard	Annual Geometric Mean ^(g)	60 µg/m ³
Secondary Standard	24 Hour ^(g)	150 µg/m ³


- (a) Not to be exceeded more than once per year.
- (b) Statistically estimated number of days with concentrations above this level averaged over a three year period, is not to be more than 1 per year.
- (c) The three year average of the fourth maximum value for each year is not to exceed this level.
- (d) The average of three years of annual averages (based on quarterly averages) is not to exceed this level.
- (e) The three year average of the 99th percentile for each year is not to exceed this level.
- (f) The three year average of the 98th percentile for each year is not to exceed this level.
- (g) The TSP standard was replaced by the PM₁₀ standard on July 1, 1987. TSP is now a State standard only and was temporarily suspended from 30 August 1993 to 30 October 1995 by the AQCC.

Colorado Water Quality Control Commission Standards for Radioactive Materials at and around RFETS

	SEGMENT 2 Standley Lake	SEGMENT 3 Great Western Reservoir	SEGMENTS 4a and 5 Woman Creek	SEGMENTS 4a, 4b and 5 Walnut Creek
Gross Alpha (pCi/L)	6	5	7	11
Gross Beta (pCi/L)	9	12	8	19
Plutonium (pCi/l)	0.03	0.03	0.15	0.15 *
Americium (pCi/l)	0.03	0.03	0.15	0.15 *
Tritium (pCi/l)	500	500	500	500
Uranium (pCi/L)	3	4	11	10

* Temporary modifications apply until December 31, 2000. The modification is a narrative standard requiring that the concentration of americium and plutonium be consistent with attaining the numerical water quality standard in Segment 4(b) of Big Dry Creek

Standards for Inorganics and Metals

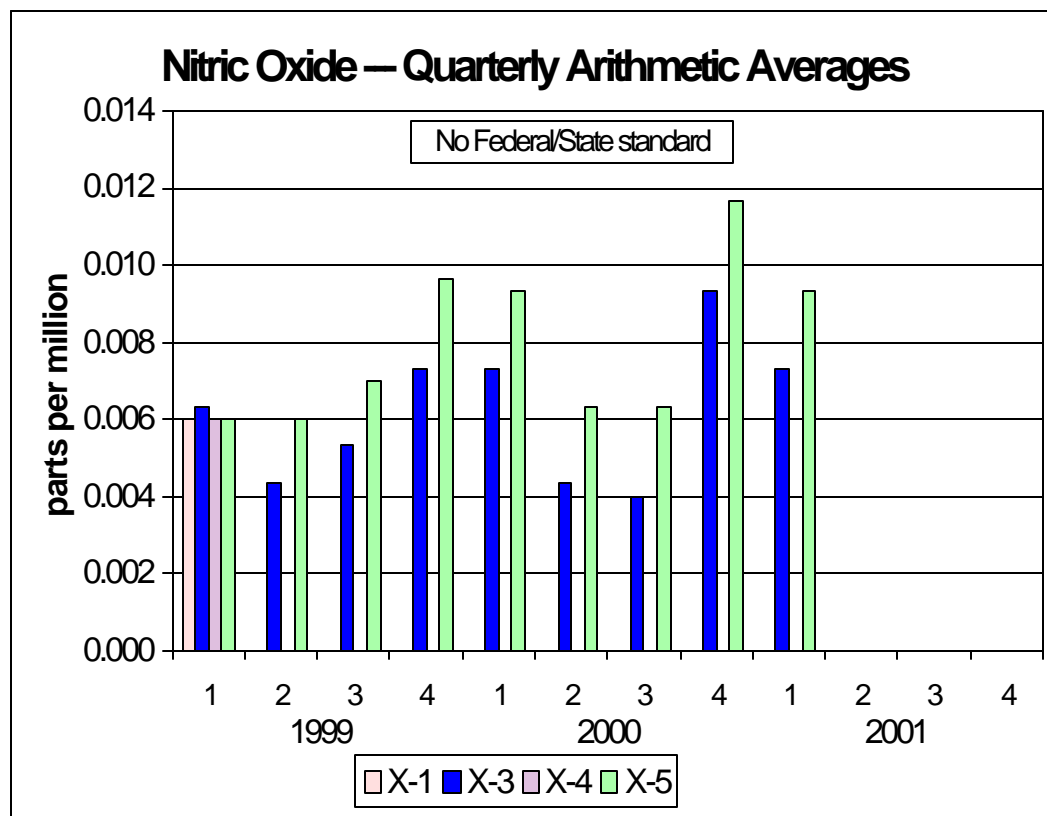

*There is no unionized ammonia standard for Segment 5 or Segment 4b. A standard of 0.1 mg/L applies to Segment 4a.

**The standards for these metals were calculated using a formula based on hardness. A hardness value of 143 mg/L was used because this is the average hardness found in these waters.

EPA Method 502.2 for VOCs in Surface Waters

VOCs	MCL ($\mu\text{g/L}$)	MDL ($\mu\text{g/L}$)	PQL ($\mu\text{g/L}$)	VOCs	MCL ($\mu\text{g/L}$)	MDL ($\mu\text{g/L}$)	PQL ($\mu\text{g/L}$)
1,1,2-Tetrachloroethane	none	0.5	1	Chloroform	none	0.5	1
1,1,1-Trichloroethane	200	0.5	1	Chloromethane	none	0.5	1
1,1,2,2-Tetrachloroethane	none	0.5	1	Dibromochloromethane	none	0.5	1
1,1,2-Trichloroethane	5	0.5	1	Dibromomethane	none	0.5	1
1,1-Dichloroethane	none	0.5	1	Dichlorodifluoromethane	none	0.5	1
1,1-Dichloroethene	7	0.5	1	Dichloromethane	5	0.5	1
1,1-Dichloropropene	none	0.5	1	Ethylbenzene	700	0.5	1
1,2,3-Trichlorobenzene	none	0.5	1	Fluorotrichloromethane	none	0.5	1
1,2,3-Trichloropropane	none	0.5	1	Hexachlorobutadiene	none	0.5	1
1,2,4-Trichlorobenzene	70	0.5	1	Isopropylbenzene	none	0.5	1
1,2,4-Trimethylbenzene	none	0.5	1	Naphthalene	none	0.5	1
1,2-Dichlorobenzene	600	0.5	1	Propylbenzene	none	0.5	1
1,2-Dichloroethane	5	0.5	1	Styrene	100	0.5	1
1,2-Dichloropropane	5	0.5	1	Tetrachloroethene	5	0.5	1
1,3,5-Trimethylbenzene	none	0.5	1	Toluene	1000	0.5	1
1,3-Dichlorobenzene	none	0.5	1	Trichloroethene	5	0.5	1
1,3-Dichloropropane	none	0.5	1	Vinyl chloride	2	0.5	1
1,4-Dichlorobenzene	75	0.5	1	Xylene, (total)	10,000	0.5	1
2,2-Dichloropropane	none	0.5	1	cis-1,2-Dichloroethene	70	0.5	1
2-Chlorotoluene	none	0.5	1	cis-1,3-Dichloropropene	none	0.5	1
4-Chlorotoluene	none	0.5	1	n-Butylbenzene	none	0.5	1
4-Isopropyltoluene	none	0.5	1	sec-Butylbenzene	none	0.5	1
Benzene	5	0.5	1	tert-Butylbenzene	none	0.5	1
Bromobenzene	none	0.5	1	trans-1,2-Dichloroethene	100	0.5	1
Chloroethane	none	0.5	1	trans-1,3-Dichloroethene	none	0.5	1

EPA Method 515.1 for Chlorinated Acid Herbicides

Contaminant	MDL ($\mu\text{g/L}$)	PQL ($\mu\text{g/L}$)	Contaminant	MDL ($\mu\text{g/L}$)	PQL ($\mu\text{g/L}$)
Acifluorfen	0.3	3	3,5-Dichlorobenzoic acid	0.8	8
Bentazon	0.4	4	Dichloroprop	0.3	3
Cloramben	1.2	12	Dinoseb	0.6	6
2,4-D	0.3	3	4-Nitrophenol	0.8	8
Dalapon	0.7	7	Pentachlorophenol	0.6	6
2,4-DB	0.5	5	Picloram	0.5	5
DCPA	0.4	4	2,4,5-T	0.3	3
Dicamba	0.3	3	2,4,5-TP	0.3	3

EPA Method 525.2 for SVOCs in Surface Waters

SVOCs	MCL (mg/L)	MDL (mg/L)	PQL (mg/L)	SVOCs	MCL (mg/L)	MDL (mg/L)	PQL (mg/L)
1,2,4-Trichlorobenzene	none	5	10	Benzo(a)anthracene	none	5	10
1,2-Dichlorobenzene	none	5	10	Benzo(a)anthracene	0.2	5	10
1,3-Dichlorobenzene	none	5	10	Benzo(b)fluoranthene	none	5	10
1,4-Dichlorobenzene	none	5	10	Benzo(ghi)perylene	none	5	10
2,4,5-Trichlorophenol	none	5	10	Benzo(k)fluoranthene	none	5	10
2,4,6-Trichlorophenol	none	5	10	Butyl benzyl phthalate	none	5	10
2,4-Dichlorophenol	none	5	10	Chrysene	none	5	10
2,4-Dimethylphenol	none	5	10	Di-n-butylphthalate	none	5	10
2,4-Dinitrophenol	none	25	10	Di-n-octylphthalate	none	5	10
2,4-Dinitrotoluene	none	5	10	Dibenz(a,h)anthracene	none	5	10
2-Chloronaphthalene	none	5	10	Dibenzofuran	none	5	10
2-Methyl-4,6-dinitrophenol	none	25	50	Diethyl phthalate	none	5	10
2-Chlorophenol	none	5	10	Dimethyl phthalate	none	5	10
2-Methylnaphthalene	none	5	10	Hexachlorobutadiene	none	5	10
2-Methylphenol	none	5	10	Hexachlorocyclopentadiene	50	5	10
2-Nitroaniline	none	5	10	Hexachloroethane	none	5	10
2-Nitrophenol	none	5	10	Indeno(1,2,3-cd)pyrene	none	5	10
3,3-Dichlorobenzidine	none	5	10	Isophorone	none	5	10
3-Nitroaniline	none	25	50	N-Nitosodi-n-propylamine	none	5	10
4-Bromophenylphenylether	none	5	10	N-Nitrosodiphenylamine	none	5	10
4-Chloro-3-methylphenol	none	10	20	Naphthalene	none	5	10
4-Chloroaniline	none	10	20	Nitrobenzene	none	5	10
4-Chlorophenylphenylether	none	5	10	Pentachlorophenol	1	25	10
4-Methylphenol	none	5	10	Phenanthrene	none	5	10
4-Nitroaniline	none	25	50	Phenol	none	5	10
4-Nitrophenol	none	25	50	Pyrene	none	5	10
Acenaphthene	none	5	10	bis(2-Chloroethoxy)methane	none	5	10
Acenaphthylene	none	5	10	bis(2-Chloroethyl) ether	none	5	10
Anthracene	none	5	10	bis(2-Ethylhexyl) phthalate	6	5	10

Description of Air Sampling this Quarter

Table A contains the complete gross alpha /gross beta results for the first quarter of 2001. Table B contains complete plutonium and americium results for the fourth quarter 1999 and for the first through third quarters of 2000. All of these data show no obvious anomalies compared to historical data.

Oxides of nitrogen and ozone data for the first quarter of 2001 are presented in Table D. Average oxides of nitrogen levels were typical to slightly higher than historical values for the period, though still very low. Maximum hourly nitric oxide levels were higher than typical for the period while nitrogen dioxide levels were more typical. Ozone concentrations for the quarter were at typically low wintertime levels. Particulate concentrations for the first quarter of 2001 are presented in Table E. Average PM₁₀ levels for the period were slightly higher than typical historical levels, but still well below the Federal standards. The 24-hour maximum PM₁₀ levels were typical. Average and maximum TSP levels were typical for the period.



No new beryllium and uranium data (Table F) are available at this time. Volatile organic compound analyses for all four quarters of 2000 are presented in Table G. These data show that, as in the past, BTEX and Freon compounds are generally detected in the highest amounts, but still at very low levels compared to workplace Threshold Limit Values. For 2000, the highest 24-hour concentrations recorded were 2.39 ppb for chloromethane at X-1, 2.37 ppb for Freon 134a at X-5, 1.42 ppb for toluene at X-3, 1.01 ppb for Freon 12 at X-4 and 0.86 ppb for benzene at X-3.



Currently, significant cuts in the CDPHE air monitoring network have been proposed. These proposed cuts are in response to the changing mission of the Rocky Flats Plant, the very low levels being monitored, and the current status of the demolition and decontamination activities. Additionally, some of the proposed cuts are to eliminate some of the redundancy between the monitoring networks. A presentation on the proposals will be formally made at an upcoming Integrated Monitoring Plan (IMP) meeting and will include:



1. Discontinuing every sixth day PM₁₀ and TSP sampling at X-1, X-2, X-3, X-4 and X-5 sites.
2. Moving some of the "D" (ground level) continuous TSP sites and analyses to some of the "X" sites.
3. Discontinuing some analyses at the E-1 elevated site.
4. Discontinuing the E-3 elevated site.
5. Discontinuing beryllium and isotopic uranium analyses from every sixth day PM₁₀ and TSP sampling at X-1, X-2, X-3, X-4 and X-5 sites.
6. Discontinuing americium and plutonium analyses from every sixth day PM₁₀ and TSP sampling at the X-5 site.
7. Discontinuing every sixth day volatile organic compound sampling at X-1, X-2, X-3, X-4 and X-5 sites.
8. Discontinuing oxides of nitrogen sampling at X-3 and X-5 sites.



Graphical Presentation



Graphs of pertinent and abnormal data from air monitoring are presented in this section.

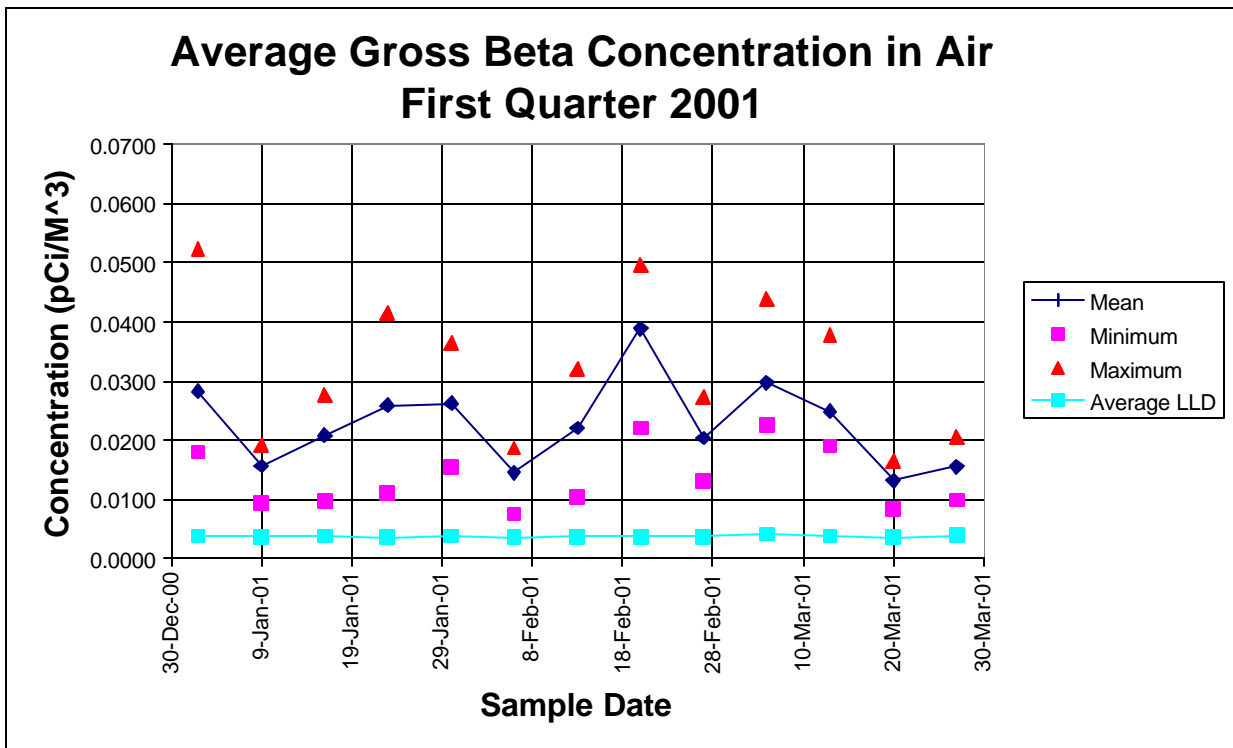
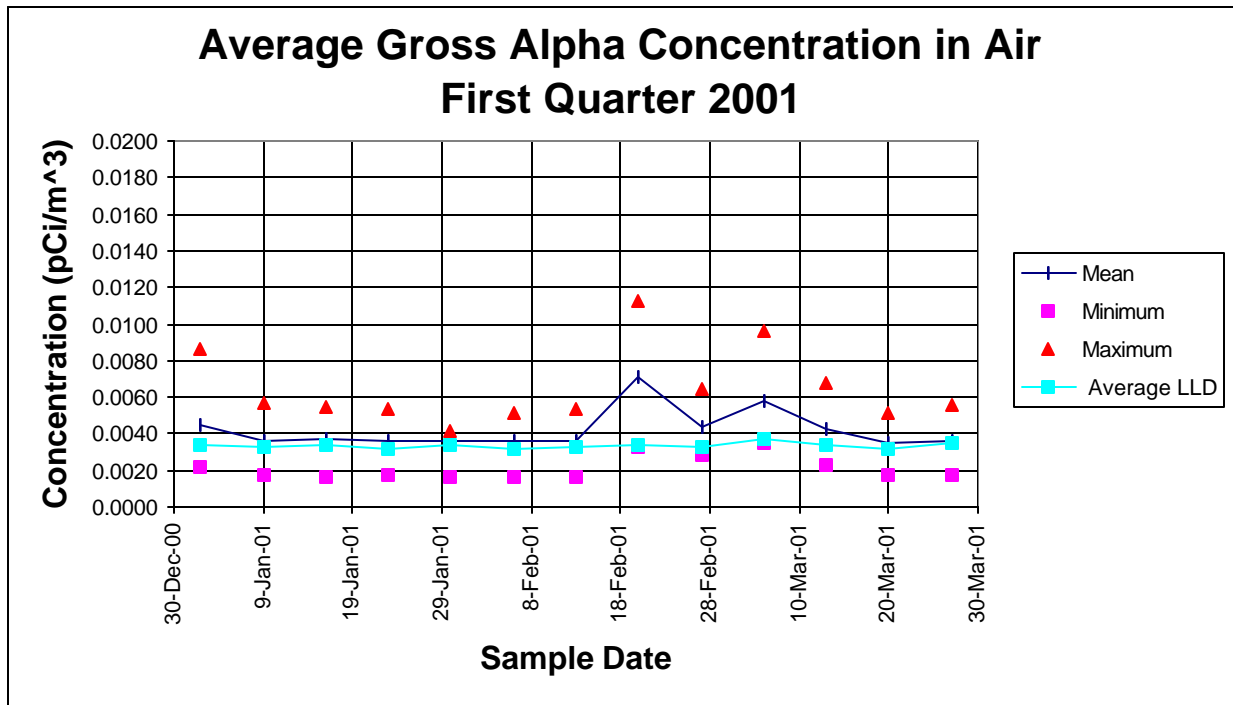


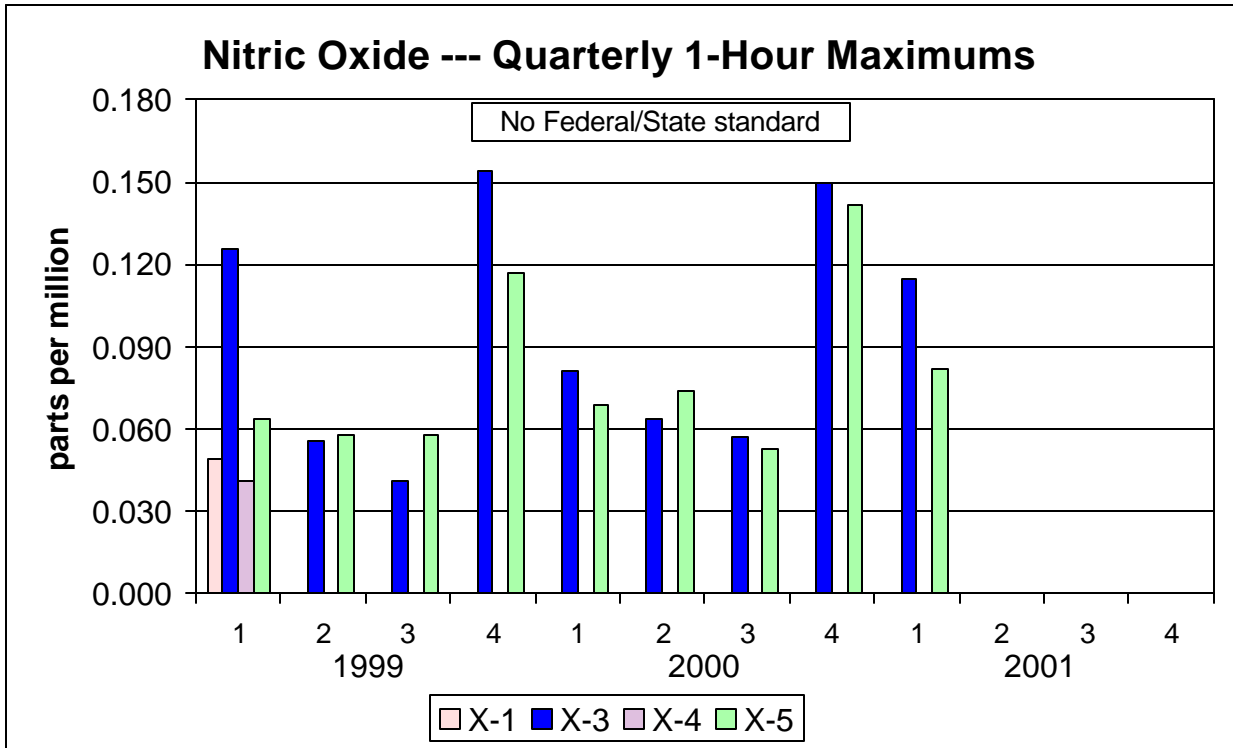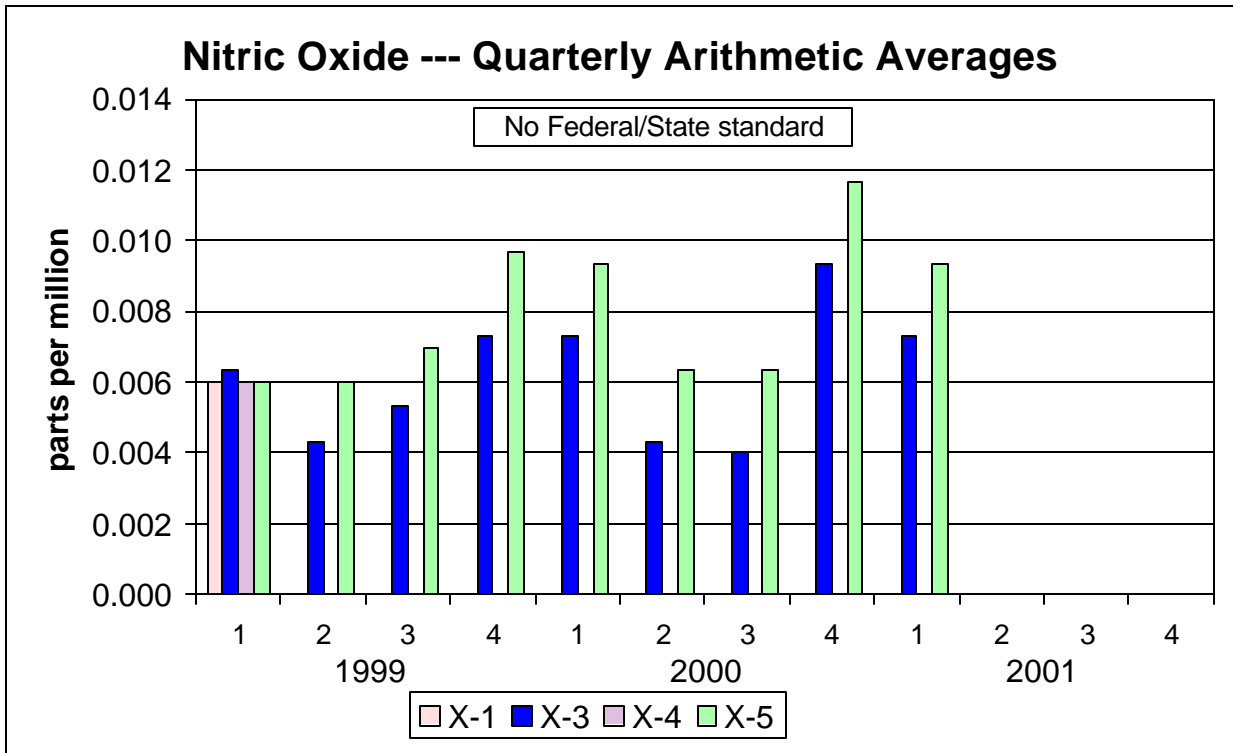

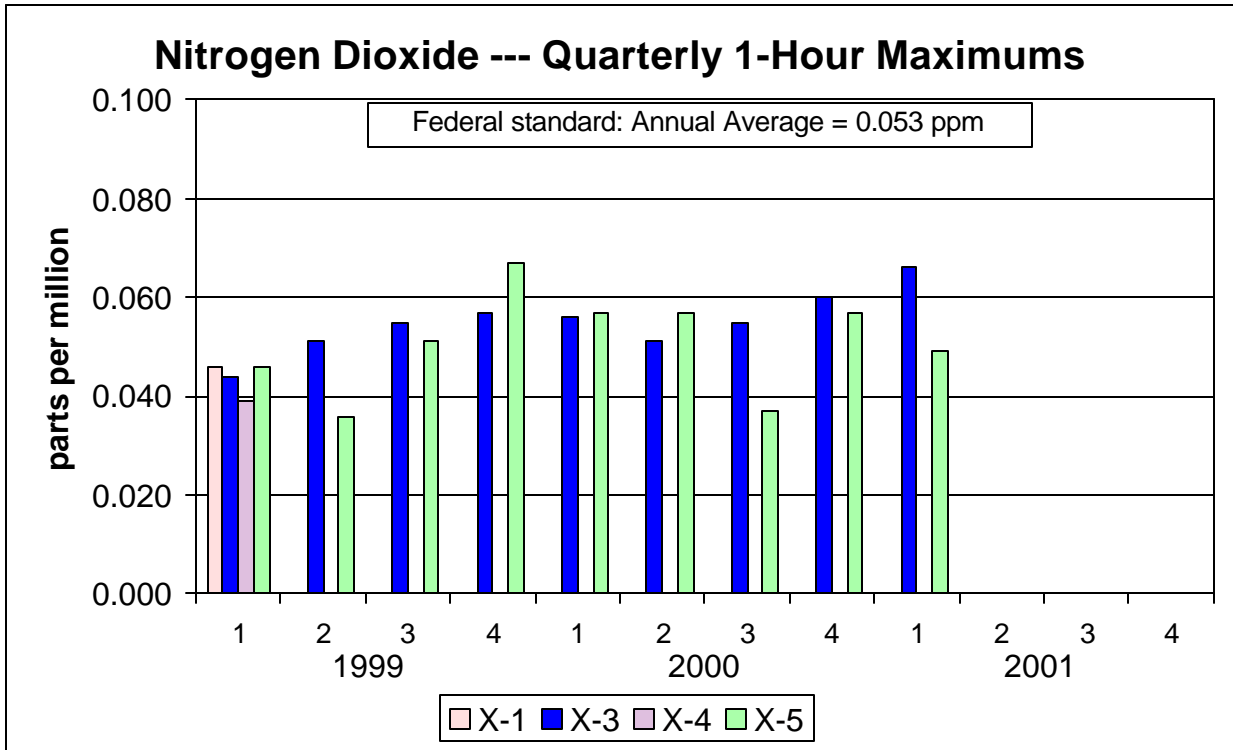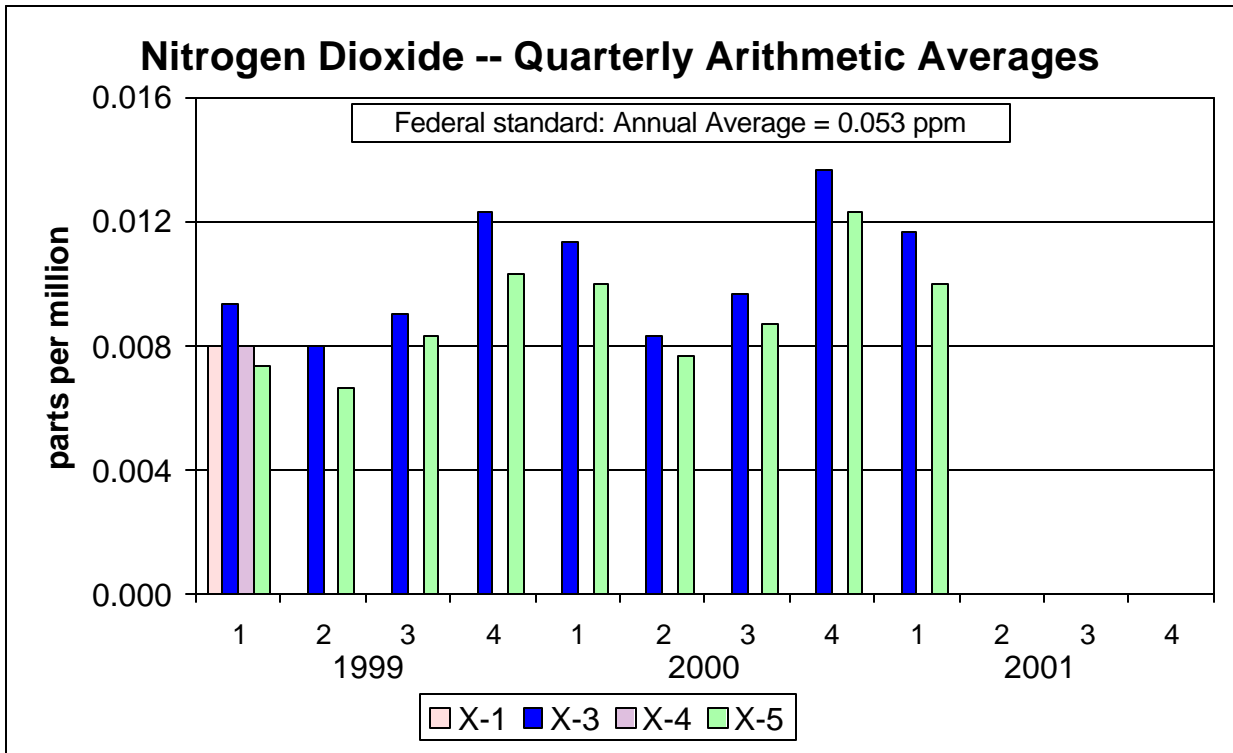

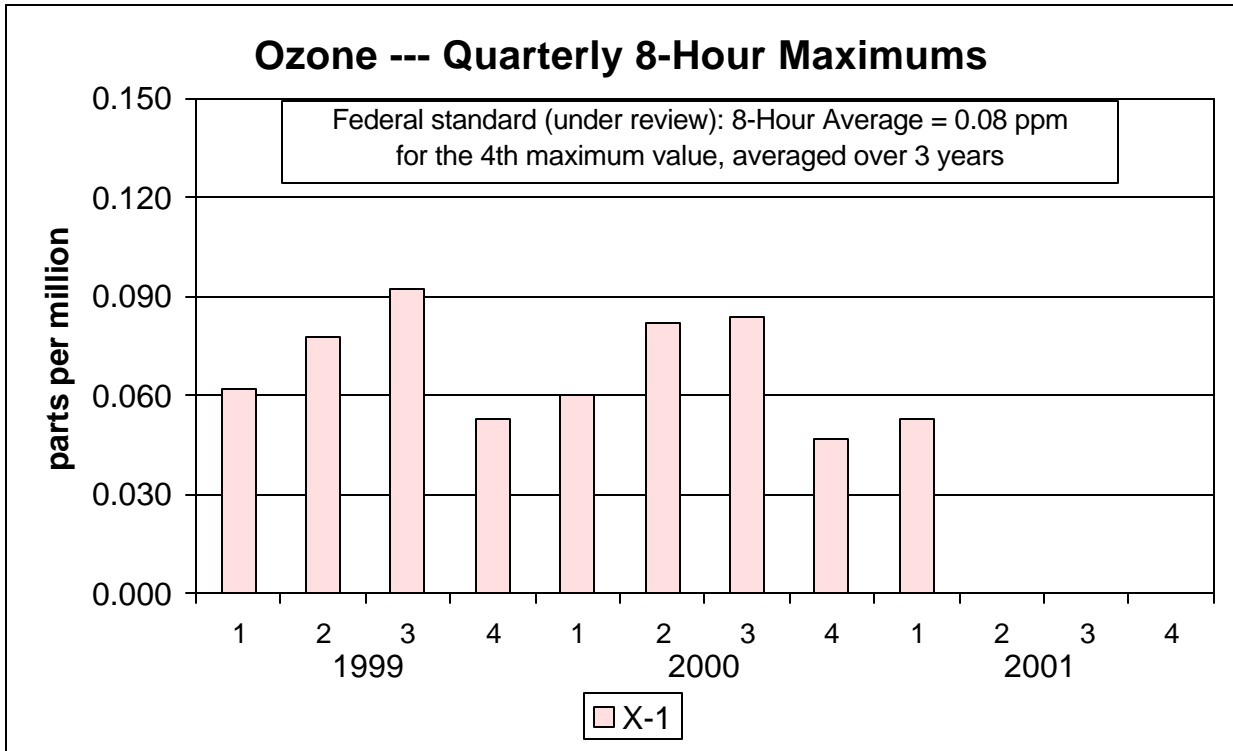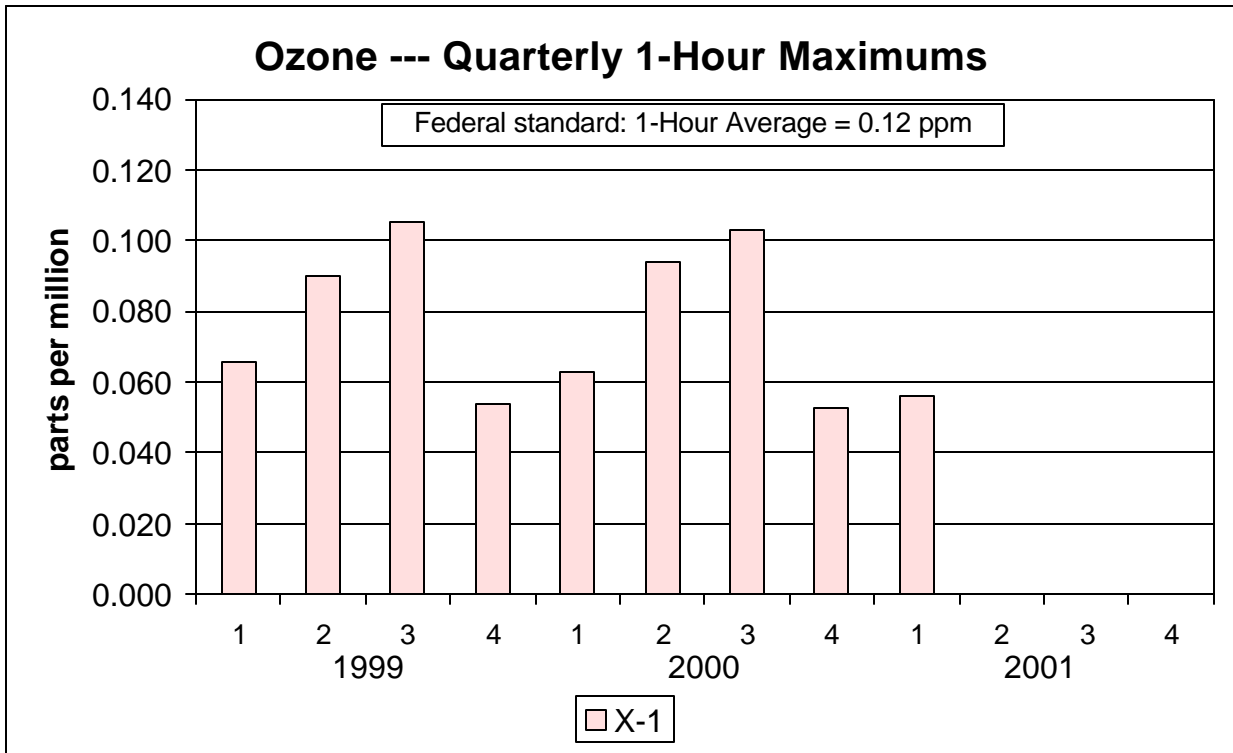

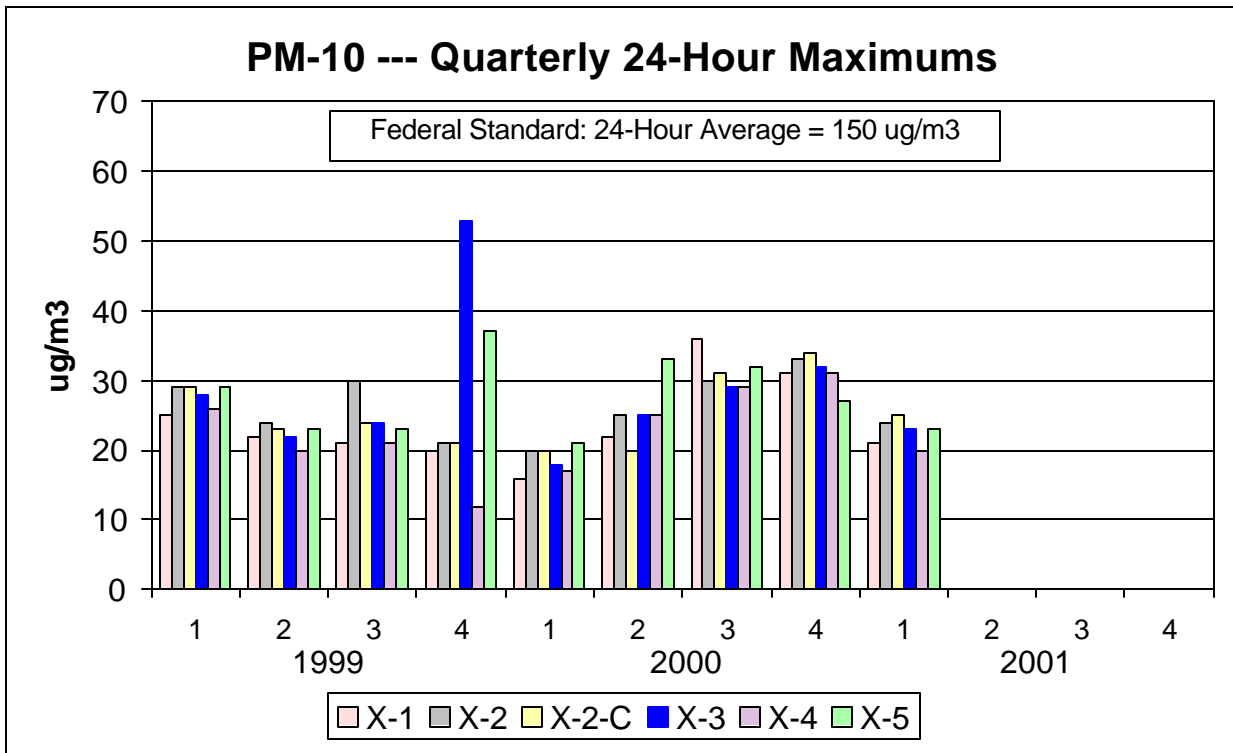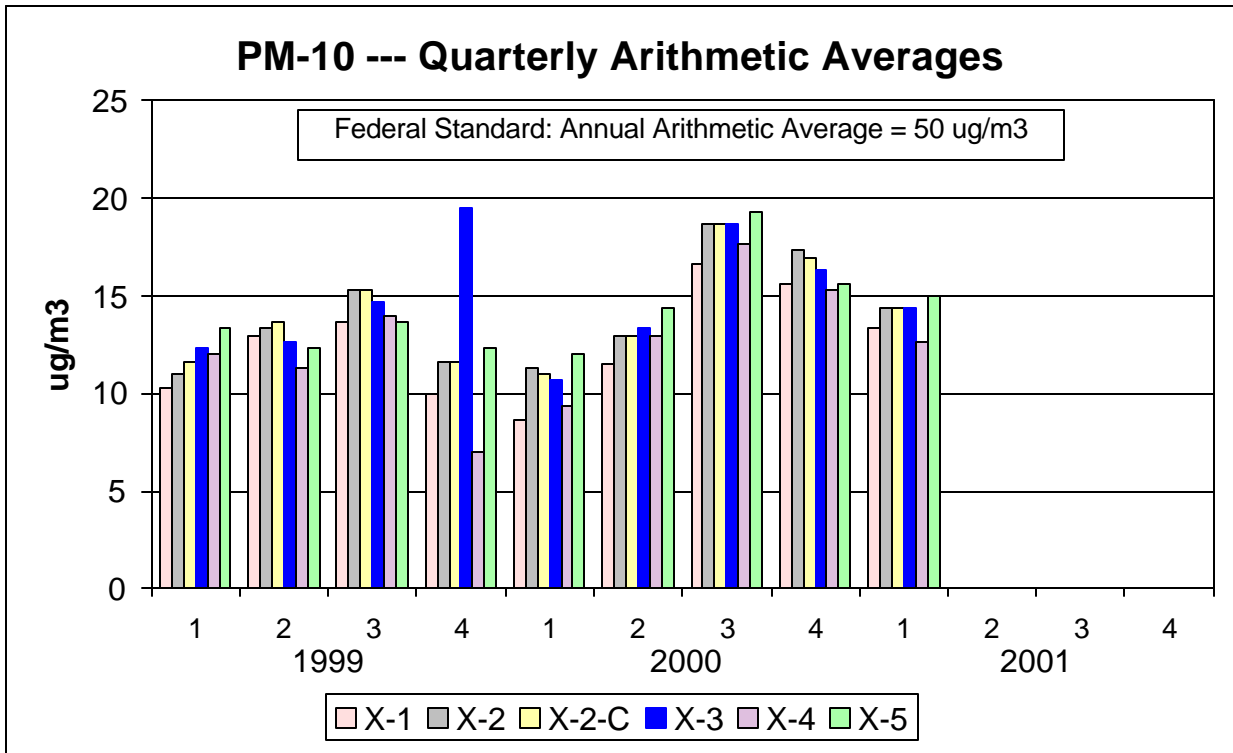

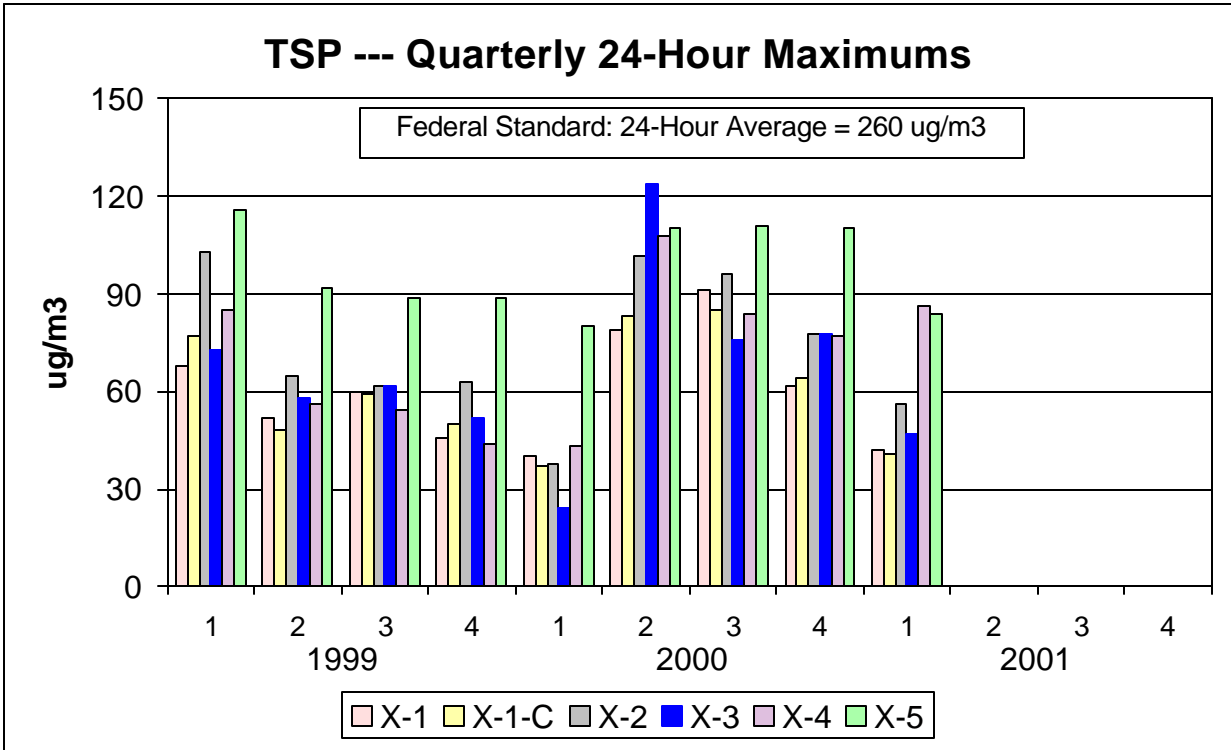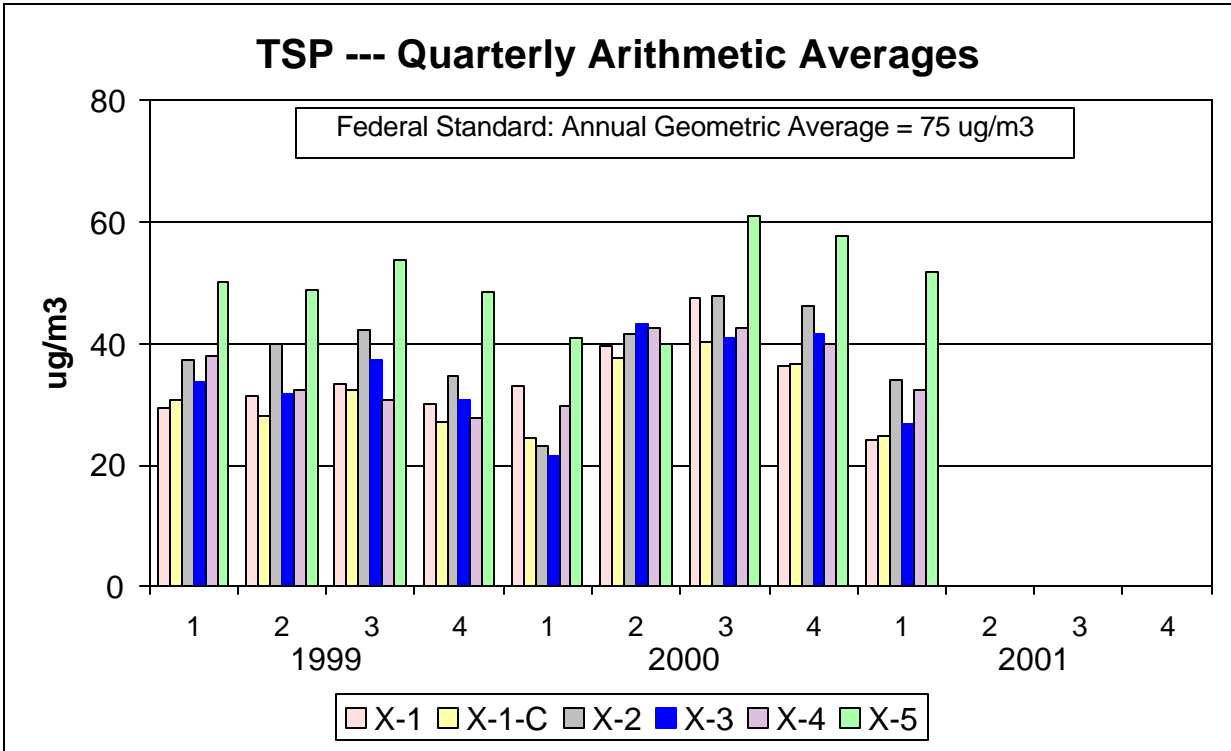

This page intentionally blank

Environmental Surveillance Report

TABLE A: GROSS ALPHA AND GROSS BETA RADIOACTIVITY CONCENTRATIONS
IN SUSPENDED AIRBORNE PARTICULATE MATERIAL

FIRST QUARTER 2001

Location	Sampler Type	Number of Samples	Gross Alpha			Gross Beta			
			Mean pCi/m ³	Max pCi/m ³	Min pCi/m ³	Mean pCi/m ³	Max pCi/m ³	Min pCi/m ³	
GROUND LEVEL SAMPLERS									
Security area:	D-1	TSP	10	< 0.0047	0.0076	0.0011	0.0266	0.0480	0.0166
	D-3	TSP	12	< 0.0046	0.0080	0.0025	0.0243	0.0490	0.0140
Buffer zone:	D-9	TSP	13	< 0.0037	0.0073	0.0014	0.0217	0.0375	0.0127
	D-10	TSP	13	< 0.0043	0.0092	0.0012	0.0226	0.0354	0.0131
	D-13	TSP	12	< 0.0048	0.0106	0.0023	0.0274	0.0496	0.0156
	D-14	TSP	12	< 0.0037	0.0063	0.0014	0.0221	0.0375	0.0103
Perimeter:	D-6	TSP	12	< 0.0043	0.0072	0.0021	0.0266	0.0469	0.0133
	D-7	TSP	12	< 0.0037	0.0078	0.0017	0.0244	0.0443	0.0138
ELEVATED SAMPLERS									
Buffer zone:	E-1-T	TSP	13	< 0.0040	0.0080	0.0023	0.0227	0.0370	0.0130
	E-2-T	TSP	10	< 0.0052	0.0114	0.0024	0.0304	0.0524	0.0127
	E-1-P	PM10	13	< 0.0023	0.0054	0.0008	0.0158	0.0286	0.0089
	E-2-P	PM10	13	< 0.0028	0.0048	0.0011	0.0169	0.0277	0.0084
Perimeter:	E-3-T	TSP	11	< 0.0042	0.0075	0.0021	0.0239	0.0463	0.0153
	E-3-P	PM10	13	< 0.0022	0.0053	0.0009	< 0.0147	0.0239	0.0076
	E-4-T	TSP	10	< 0.0033	0.0052	0.0017	< 0.0214	0.0318	0.0114

pCi/m³ = Picocuries per cubic meter

TSP = Total Suspended Particulates
PM10 = Particulate Material < 10 microns in diameter

Environmental Surveillance Report

TABLE B: ALPHA SPECTROMETRIC ANALYSIS AND LONG-LIVED GROSS ALPHA RADIOACTIVITY
CONCENTRATIONS IN SUSPENDED AIRBORNE PARTICULATE MATERIAL

FOURTH QUARTER 1999

Location	Sampler Type	²³⁹⁺²⁴⁰ Pu pCi/m ³	²⁴¹ Am pCi/m ³	²³⁹⁺²⁴⁰ Pu / ²⁴¹ Am Ratio	²³⁴ U / ²³⁸ U Ratio	Long-Lived Gross Alpha pCi/m ³
D-1	TSP / Continuous	0.000011 +/- 0.000005	< 0.000007	---		0.0063
D-3	TSP / Continuous	0.000209 +/- 0.000020	0.000021 +/- 0.000006	10.0 +/- 3.0		0.0072
D-6	TSP / Continuous	< 0.000013	< 0.000011	---		0.0072
D-7	TSP / Continuous	< 0.000008	< 0.000017	---		< 0.0061
D-13	TSP / Continuous	0.000023 +/- 0.000006	< 0.000007	---		0.0073
E-1-T	TSP / Continuous	0.000009 +/- 0.000004	< 0.000007	---		< 0.0063
E-1-P	PM10 / Continuous	< 0.000003	< 0.000002	---		0.0049
E-3-T	TSP / Continuous	< 0.000012	< 0.000014	---		< 0.0055
E-3-P	PM10 / Continuous	< 0.000003	< 0.000002	---		0.0046
E-4-T	TSP / Continuous	< 0.000008	< 0.000014	---		< 0.0048

pCi/m³ = Picocuries per cubic meter

TSP = Total Suspended Particulates

PM10 = Particulate Material < 10 microns in diameter

TSP - CL = Collocated Sampler - Total Suspended Particulates

PM10 - CL = Collocated Sampler - Particulate Material < 10 microns in diameter

Environmental Surveillance Report

TABLE B: ALPHA SPECTROMETRIC ANALYSIS AND LONG-LIVED GROSS ALPHA RADIOACTIVITY
CONCENTRATIONS IN SUSPENDED AIRBORNE PARTICULATE MATERIAL

FIRST QUARTER 2000

Location	Sampler Type	²³⁹⁺²⁴⁰ Pu pCi/m ³	²⁴¹ Am pCi/m ³	²³⁹⁺²⁴⁰ Pu / ²⁴¹ Am Ratio	²³⁴ U / ²³⁸ U Ratio	Long-Lived Gross Alpha pCi/m ³
D-1	TSP / Continuous	< 0.000013	< 0.000011	---		0.0078
D-3	TSP / Continuous	0.000198 +/- 0.000022	0.000007 +/- 0.000004	28.3 +/- 16.5		< 0.0071
D-6	TSP / Continuous	< 0.000010	< 0.000012	---		< 0.0069
D-7	TSP / Continuous	< 0.000010	< 0.000010	---		0.0069
D-13	TSP / Continuous	0.000011 +/- 0.000005	< 0.000007	---		< 0.0061
E-1-T	TSP / Continuous	0.000013 +/- 0.000003	< 0.000007	---		0.0067
E-1-P	PM10 / Continuous	< 0.000015	< 0.000002	---		< 0.0055
E-3-T	TSP / Continuous	< 0.000013	< 0.000012	---		< 0.0066
E-3-P	PM10 / Continuous	< 0.000008	< 0.000020	---		0.0044
E-4-T	TSP / Continuous	< 0.000025	< 0.000019	---		0.0062

pCi/m³ = Picocuries per cubic meter

TSP = Total Suspended Particulates

PM10 = Particulate Material < 10 microns in diameter

TSP - CL = Collocated Sampler - Total Suspended Particulates

PM10 - CL = Collocated Sampler - Particulate Material < 10 microns in diameter

Environmental Surveillance Report

**TABLE B: ALPHA SPECTROMETRIC ANALYSIS AND LONG-LIVED GROSS ALPHA RADIOACTIVITY
CONCENTRATIONS IN SUSPENDED AIRBORNE PARTICULATE MATERIAL**

SECOND QUARTER 2000

Location	Sampler Type	²³⁹⁺²⁴⁰ Pu pCi/m ³	²⁴¹ Am pCi/m ³	²³⁹⁺²⁴⁰ Pu / ²⁴¹ Am Ratio	²³⁴ U / ²³⁸ U Ratio	Long-Lived Gross Alpha pCi/m ³
D-1	TSP / Continuous	< 0.000023	< 0.000020	---		< 0.0046
D-3	TSP / Continuous	0.000099 +/- 0.000028	0.000023 +/- 0.000015	4.3 +/- 3.1		< 0.0039
D-6	TSP / Continuous	< 0.000016	< 0.000038	---		0.0048
D-7	TSP / Continuous	< 0.000011	< 0.000018	---		< 0.0045
D-13	TSP / Continuous	0.000027 +/- 0.000013	< 0.000018	---		< 0.0042
E-1-T	TSP / Continuous	< 0.000011	0.000006 +/- 0.000007	---		0.0044
E-1-P	PM10 / Continuous	< 0.000004	< 0.000005	---		< 0.0024
E-3-T	TSP / Continuous	< 0.000014	< 0.000015	---		< 0.0038
E-3-P	PM10 / Continuous	< 0.000002	< 0.000010	---		< 0.0021
E-4-T	TSP / Continuous	< 0.000005	< 0.000016	---		< 0.0054

pCi/m³ = Picocuries per cubic meter

TSP = Total Suspended Particulates

PM10 = Particulate Material < 10 microns in diameter

TSP - CL = Collocated Sampler - Total Suspended Particulates

PM10 - CL = Collocated Sampler - Particulate Material < 10 microns in diameter

Environmental Surveillance Report

TABLE B: ALPHA SPECTROMETRIC ANALYSIS AND LONG-LIVED GROSS ALPHA RADIOACTIVITY
CONCENTRATIONS IN SUSPENDED AIRBORNE PARTICULATE MATERIAL

THIRD QUARTER 2000

Location	Sampler Type	²³⁹⁺²⁴⁰ Pu pCi/m ³	²⁴¹ Am pCi/m ³	²³⁹⁺²⁴⁰ Pu / ²⁴¹ Am Ratio	²³⁴ U / ²³⁸ U Ratio	Long-Lived Gross Alpha pCi/m ³
D-1	TSP / Continuous	0.000018 +/- 0.000006	< 0.000006	---		< 0.0053
D-3	TSP / Continuous	0.000166 +/- 0.000048	0.000018 +/- 0.000004	9.2 +/- 3.4		< 0.0063
D-6	TSP / Continuous	< 0.000005	< 0.000007	---		0.0048
D-7	TSP / Continuous	< 0.000005	< 0.000005	---		0.0049
D-13	TSP / Continuous	< 0.000010	< 0.000004	---		0.0054
E-1-T	TSP / Continuous	0.000009 +/- 0.000005	< 0.000009	---		< 0.0044
E-1-P	PM10 / Continuous	< 0.000001	< 0.000001	---		< 0.0022
E-3-T	TSP / Continuous	< 0.000012	< 0.000008	---		< 0.0045
E-3-P	PM10 / Continuous	< 0.000003	< 0.000001	---		< 0.0023
E-4-T	TSP / Continuous	< 0.000028	< 0.000005	---		0.0055

pCi/m³ = Picocuries per cubic meter

TSP = Total Suspended Particulates

PM10 = Particulate Material < 10 microns in diameter

TSP - CL = Collocated Sampler - Total Suspended Particulates

PM10 - CL = Collocated Sampler - Particulate Material < 10 microns in diameter

Environmental Surveillance Report

**TABLE B: ALPHA SPECTROMETRIC ANALYSIS AND LONG-LIVED GROSS ALPHA RADIOACTIVITY
CONCENTRATIONS IN SUSPENDED AIRBORNE PARTICULATE MATERIAL**

FOURTH QUARTER 2000, FIRST QUARTER 2001

Location	Sampler Type	$^{239+240}\text{Pu}$ pCi/m ³	^{241}Am pCi/m ³	$^{239+240}\text{Pu} / ^{241}\text{Am}$ Ratio	$^{234}\text{U} / ^{238}\text{U}$ Ratio	Long-Lived Gross Alpha pCi/m ³
D-1	TSP / Continuous					
D-3	TSP / Continuous					
D-6	TSP / Continuous					
D-7	TSP / Continuous					
D-13	TSP / Continuous					
E-1-T	TSP / Continuous					
E-1-P	PM10 / Continuous					
E-3-T	TSP / Continuous					
E-3-P	PM10 / Continuous					
E-4-T	TSP / Continuous					

DATA NOT YET AVAILABLE

pCi/m³ = Picocuries per cubic meter
TSP = Total Suspended Particulates
PM10 = Particulate Material < 10 microns in diameter
TSP - CL = Collocated Sampler - Total Suspended Particulates
PM10 - CL = Collocated Sampler - Particulate Material < 10 microns in diameter

Environmental Surveillance Report

TABLE D: INORGANIC GASEOUS COMPOUNDS IN AIR

FIRST QUARTER 2001

Compound	North Site (X-1) (Hourly values)			Southeast Site (X-3) (Hourly values)			West Site (X-5) (Hourly values)		
	Avg ppm	Max ppm	# Hours	Avg ppm	Max ppm	# Hours	Avg ppm	Max ppm	# Hours
<u>JANUARY 2001</u>									
Nitric Oxide (NO)	---	---	---	0.007	0.115	697	0.011	0.082	698
Nitrogen Dioxide (NO ₂)	---	---	---	0.012	0.050	697	0.011	0.069	698
Ozone (O ₃)	0.028	0.052	731	---	---	---	---	---	---
<u>FEBRUARY 2001</u>									
Nitric Oxide (NO)	---	---	---	0.009	0.080	634	0.011	0.065	641
Nitrogen Dioxide (NO ₂)	---	---	---	0.014	0.066	634	0.012	0.049	641
Ozone (O ₃)	0.024	0.052	659	---	---	---	---	---	---
<u>MARCH 2001</u>									
Nitric Oxide (NO)	---	---	---	0.006	0.076	689	0.006	0.033	92
Nitrogen Dioxide (NO ₂)	---	---	---	0.009	0.047	689	0.007	0.023	92
Ozone (O ₃)	0.031	0.056	724	---	---	---	---	---	---

ppm = Parts per million
N/A = Not available

Environmental Surveillance Report

TABLE E: SUSPENDED PARTICULATE MATERIAL IN AIR

FIRST QUARTER 2001

Item	North Site (X-1) (Daily values)			Northeast Site (X-2) (Daily values)			Southeast Site (X-3) (Daily values)			South Site (X-4) (Daily values)			West Site (X-5) (Daily values)		
	Avg ug/m ³	Max ug/m ³	#	Avg ug/m ³	Max ug/m ³	#	Avg ug/m ³	Max ug/m ³	#	Avg ug/m ³	Max ug/m ³	#	Avg ug/m ³	Max ug/m ³	#
JANUARY 2001															
TSP-P	24	42	6	33	56	6	25	34	6	41	86	6	48	64	6
PM10-P	16	21	6	14	24	6	14	22	6	13	18	6	13	21	6
TSP-CL	26	41	6												
PM10-CL				17	25	5									
FEBRUARY 2001															
TSP-P	24	35	4	36	39	3	25	33	4	30	45	4	59	84	3
PM10-P	12	17	4	15	18	4	15	19	4	14	19	3	17	23	3
TSP-CL	25	35	4												
PM10-CL				12	16	3									
MARCH 2001															
TSP-P	24	40	5	33	52	5	30	47	5	26	37	3	48	48	2
PM10-P	12	20	4	14	24	5	14	23	5	11	20	5	15	21	2
TSP-CL	23	39	5												
PM10-CL				14	23	5									

ug/m³ = Micrograms per cubic meter
N/A = Not available

TSP = Total Suspended Particulates (P = primary, CL = collocated)
PM10 = Particulate Matter < 10 microns in diameter (P = primary, CL = collocated)

Environmental Surveillance Report

TABLE F: METALS IN AIR

SECOND - FOURTH QUARTER 2000, FIRST QUARTER 2001

	North Site (X-1) (Quarterly composites) ug/m ³	Northeast Site (X-2) (Quarterly composites) ug/m ³	Southeast Site (X-3) (Quarterly composites) ug/m ³	South Site (X-4) (Quarterly composites) ug/m ³	West Site (X-5) (Quarterly composites) ug/m ³
Metal					
Beryllium -- TSP-P					
Beryllium -- PM10-P					
Beryllium -- TSP-CL					
Beryllium -- PM10-CL					
Uranium -- TSP					
Uranium -- PM10					
Uranium -- TSP-CL					
Uranium -- PM10-CL					

DATA NOT YET AVAILABLE

ug/m³ = Micrograms per cubic meter

N/A = Not available

TSP = Total Suspended Particulates (P = primary, CL = collocated)

PM10 = Particulate Matter < 10 microns in diameter (P = primary, CL = collocated)

Environmental Surveillance Report

TABLE G: VOLATILE ORGANIC COMPOUNDS IN AIR

FIRST QUARTER 2000

Compound	CAS #	TLV ppm	North site (X-1) (Daily averages)		Northeast site (X-2) (Daily averages)		Southeast site (X-3) (Daily averages)		South site (X-4) (Daily averages)		West site (X-5) (Daily averages)	
			Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb
Freon 134a	811-97-2		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Freon 22	75-45-6	1000	0.00	0.00	0.02	0.09	0.00	0.06	0.00	0.00	0.00	0.07
Freon 12	75-71-8	1000	0.44	0.62	0.30	0.45	0.29	0.47	0.37	0.60	0.21	0.34
Chloromethane	74-87-3	50	0.14	0.52	0.08	0.26	0.08	0.23	0.12	0.33	0.09	0.30
Freon 114	76-14-2	1000	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00
Vinyl chloride	75-01-4	5	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
1,3-Butadiene	106-99-0	2	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Chloroethane	75-00-3	100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Freon 123	306-83-2		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Freon 11	75-69-4	1000	0.08	0.13	0.12	0.17	0.12	0.21	0.11	0.17	0.05	0.08
Vinylidene chloride	75-35-4	5	0.00	0.05	0.01	0.03	0.01	0.03	0.01	0.03	0.00	0.03
Dichloromethane	75-09-2	50	0.01	0.04	0.04	0.12	0.04	0.14	0.03	0.14	0.01	0.05
Freon 113	76-13-1	1000	0.09	0.10	0.08	0.09	0.08	0.10	0.09	0.12	0.04	0.07
Methyl tert-butyl ether	1634-04-4	40	0.01	0.19	0.02	0.10	0.01	0.09	0.02	0.12	0.01	0.10
1,1-Dichloroethane	75-34-3	100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

ppb = Parts per billion
 ppm = Parts per million
 nd = Not detected

N/A = Not available
 TLV = ACGIH Threshold Limit Value
 CAS # = Chemical Abstracts Service number

Environmental Surveillance Report

TABLE G: VOLATILE ORGANIC COMPOUNDS IN AIR (continued)

FIRST QUARTER 2000

Compound	CAS #	TLV Ppm	North site (X-1) (Daily averages)		Northeast site (X-2) (Daily averages)		Southeast site (X-3) (Daily averages)		South site (X-4) (Daily averages)		West site (X-5) (Daily averages)	
			Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max Ppb
Chloroform	67-66-3	10	0.02	0.11	0.02	0.06	0.02	0.05	0.02	0.08	0.01	0.07
1,2-Dichloroethane	107-06-2	10	0.00	0.00	0.00	0.02	0.00	0.02	0.00	0.02	0.00	0.00
1,1,1-Trichloroethane	71-55-6	350	0.08	0.12	0.05	0.08	0.05	0.07	0.07	0.10	0.04	0.07
Carbon tetrachloride	56-23-5	5	0.13	0.17	0.11	0.13	0.09	0.13	0.12	0.15	0.08	0.10
Benzene	71-43-2	0.1	0.21	0.41	0.29	0.50	0.27	0.47	0.26	0.45	0.12	0.28
Trichloroethene	79-01-6	50	0.01	0.07	0.02	0.09	0.02	0.08	0.02	0.11	0.01	0.05
1,1,2-Trichloroethane	79-00-5	10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Toluene	108-88-3	50	0.25	0.59	0.34	0.77	0.33	0.86	0.27	0.70	0.13	0.45
Tetrachloroethene	127-18-4	25	0.02	0.08	0.03	0.06	0.02	0.05	0.03	0.06	0.01	0.04
Chlorobenzene	108-90-7	10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Ehtyl benzene	100-41-4	100	0.04	0.15	0.04	0.11	0.04	0.11	0.05	0.14	0.03	0.09
m- + p-Xylene	N/A	100	0.08	0.28	0.09	0.33	0.09	0.37	0.09	0.49	0.04	0.15
Styrene	100-42-5	50	0.01	0.09	0.01	0.05	0.01	0.04	0.02	0.05	0.01	0.05
1,1,2,2-o-Xylene	79-34-5	1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	95-47-6	100	0.04	0.10	0.03	0.10	0.03	0.11	0.03	0.14	0.02	0.07

ppb = Parts per billion
ppm = Parts per million
nd = Not detected

N/A = Not available
TLV = ACGIH Threshold Limit Value
CAS # = Chemical Abstracts Service number

Environmental Surveillance Report

TABLE G: VOLATILE ORGANIC COMPOUNDS IN AIR

SECOND QUARTER 2000

Compound	CAS #	TLV ppm	North site (X-1) (Daily averages)		Northeast site (X-2) (Daily averages)		Southeast site (X-3) (Daily averages)		South site (X-4) (Daily averages)		West site (X-5) (Daily averages)	
			Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb
Freon 134a	811-97-2		0.01	0.12	0.00	0.00	0.00	0.00	0.00	0.00	0.06	0.86
Freon 22	75-45-6	1000	0.00	0.00	0.00	0.05	0.00	0.00	0.00	0.00	0.00	0.00
Freon 12	75-71-8	1000	0.45	0.95	0.34	0.53	0.32	0.58	0.37	0.64	0.26	0.55
Chloromethane	74-87-3	50	0.00	0.00	0.02	0.14	0.01	0.13	0.01	0.15	0.00	0.03
Freon 114	76-14-2	1000	0.01	0.03	0.01	0.02	0.01	0.02	0.01	0.02	0.00	0.02
Vinyl chloride	75-01-4	5	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
1,3-Butadiene	106-99-0	2	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Chloroethane	75-00-3	100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Freon 123	306-83-2		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Freon 11	75-69-4	1000	0.10	0.30	0.14	0.28	0.17	0.37	0.15	0.27	0.08	0.20
Vinylidene chloride	75-35-4	5	0.00	0.00	0.02	0.05	0.02	0.05	0.03	0.07	0.00	0.00
Dichloromethane	75-09-2	50	0.03	0.13	0.04	0.15	0.04	0.16	0.03	0.12	0.01	0.06
Freon 113	76-13-1	1000	0.09	0.22	0.08	0.16	0.08	0.17	0.09	0.18	0.04	0.11
Methyl tert-butyl ether	1634-04-	40	0.00	0.00	0.00	0.05	0.00	0.04	0.00	0.00	0.00	0.00
1,1-Dichloroethane	75-34-3	100	0.00	0.00	0.00	0.02	0.00	0.00	0.00	0.00	0.00	0.00

ppb = Parts per billion
 ppm = Parts per million
 nd = Not detected

N/A = Not available
 TLV = ACGIH Threshold Limit Value
 CAS # = Chemical Abstracts Service number

Environmental Surveillance Report

TABLE G: VOLATILE ORGANIC COMPOUNDS IN AIR (continued)

SECOND QUARTER 2000

Compound	CAS #	TLV Ppm	North site (X-1) (Daily averages)		Northeast site (X-2) (Daily averages)		Southeast site (X-3) (Daily averages)		South site (X-4) (Daily averages)		West site (X-5) (Daily averages)	
			Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max Ppb
Chloroform	67-66-3	10	0.02	0.11	0.02	0.06	0.02	0.05	0.02	0.07	0.01	0.06
1,2-Dichloroethane	107-06-2	10	0.00	0.00	0.00	0.04	0.01	0.04	0.00	0.00	0.00	0.04
1,1,1-Trichloroethane	71-55-6	350	0.07	0.13	0.05	0.08	0.04	0.07	0.06	0.09	0.04	0.08
Carbon tetrachloride	56-23-5	5	0.10	0.18	0.09	0.13	0.08	0.10	0.10	0.14	0.06	0.11
Benzene	71-43-2	0.1	0.11	0.17	0.17	0.28	0.17	0.27	0.14	0.19	0.08	0.12
Trichloroethene	79-01-6	50	0.00	0.00	0.01	0.09	0.01	0.08	0.00	0.00	0.00	0.00
1,1,2-Trichloroethane	79-00-5	10	0.00	0.00	0.00	0.06	0.00	0.00	0.00	0.00	0.00	0.00
Toluene	108-88-3	50	0.10	0.23	0.19	0.37	0.21	0.36	0.12	0.21	0.06	0.17
Tetrachloroethene	127-18-4	25	0.00	0.00	0.01	0.02	0.01	0.03	0.01	0.03	0.00	0.00
Chlorobenzene	108-90-7	10	0.00	0.00	0.00	0.03	0.00	0.02	0.00	0.00	0.00	0.00
Ehtyl benzene	100-41-4	100	0.00	0.00	0.00	0.04	0.00	0.02	0.00	0.00	0.00	0.00
m- + p-Xylene	N/A	100	0.00	0.04	0.02	0.11	0.01	0.06	0.01	0.03	0.01	0.05
Styrene	100-42-5	50	0.00	0.00	0.00	0.04	0.00	0.03	0.00	0.00	0.00	0.00
1,1,2,2-o-Xylene	79-34-5	1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	95-47-6	100	0.00	0.00	0.00	0.03	0.00	0.02	0.00	0.00	0.00	0.00

ppb = Parts per billion
ppm = Parts per million
nd = Not detected

N/A = Not available
TLV = ACGIH Threshold Limit Value
CAS # = Chemical Abstracts Service number

Environmental Surveillance Report

**TABLE G: VOLATILE ORGANIC COMPOUNDS IN AIR
THIRD QUARTER 2000**

Compound	CAS #	TLV ppm	North site (X-1) (Daily averages)		Northeast site (X-2) (Daily averages)		Southeast site (X-3) (Daily averages)		South site (X-4) (Daily averages)		West site (X-5) (Daily averages)	
			Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max Ppb	Avg ppb	Max ppb	Avg ppb	Max ppb
Freon 134a	811-97-2		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Freon 22	75-45-6	1000	0.00	0.00	0.04	0.31	0.01	0.16	0.00	0.00	0.04	0.35
Freon 12	75-71-8	1000	0.45	0.80	0.36	0.63	0.32	0.53	0.41	1.01	0.27	0.62
Chloromethane	74-87-3	50	0.01	0.06	0.02	0.09	0.02	0.08	0.02	0.11	0.01	0.03
Freon 114	76-14-2	1000	0.00	0.00	0.00	0.01	0.00	0.01	0.00	0.01	0.00	0.01
Vinyl chloride	75-01-4	5	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
1,3-Butadiene	106-99-0	2	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Chloroethane	75-00-3	100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Freon 123	306-83-2		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Freon 11	75-69-4	1000	0.11	0.18	0.11	0.30	0.13	0.33	0.14	0.32	0.06	0.12
Vinylidene chloride	75-35-4	5	0.00	0.00	0.01	0.03	0.03	0.05	0.00	0.02	0.00	0.00
Dichloromethane	75-09-2	50	0.05	0.21	0.06	0.14	0.07	0.19	0.06	0.11	0.02	0.08
Freon 113	76-13-1	1000	0.09	0.27	0.08	0.23	0.08	0.22	0.08	0.23	0.05	0.13
Methyl tert-butyl ether	1634-04-	40	0.00	0.00	0.00	0.00	0.01	0.11	0.00	0.00	0.00	0.00
1,1-Dichloroethane	75-34-3	100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

ppb = Parts per billion
ppm = Parts per million
nd = Not detected

N/A = Not available
TLV = ACGIH Threshold Limit Value
CAS # = Chemical Abstracts Service number

Environmental Surveillance Report

TABLE G: VOLATILE ORGANIC COMPOUNDS IN AIR (continued)

THIRD QUARTER 2000

Compound	CAS #	TLV Ppm	North site (X-1) (Daily averages)		Northeast site (X-2) (Daily averages)		Southeast site (X-3) (Daily averages)		South site (X-4) (Daily averages)		West site (X-5) (Daily averages)	
			Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max Ppb
Chloroform	67-66-3	10	0.00	0.00	0.02	0.07	0.01	0.06	0.02	0.08	0.01	0.07
1,2-Dichloroethane	107-06-2	10	0.00	0.00	0.00	0.00	0.00	0.04	0.00	0.00	0.00	0.00
1,1,1-Trichloroethane	71-55-6	350	0.09	0.15	0.05	0.08	0.04	0.07	0.06	0.10	0.05	0.09
Carbon tetrachloride	56-23-5	5	0.15	0.21	0.09	0.14	0.09	0.11	0.12	0.17	0.09	0.12
Benzene	71-43-2	0.1	0.14	0.27	0.17	0.30	0.19	0.28	0.15	0.22	0.09	0.12
Trichloroethene	79-01-6	50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
1,1,2-Trichloroethane	79-00-5	10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Toluene	108-88-3	50	0.19	0.45	0.26	0.51	0.31	0.59	0.22	0.45	0.11	0.22
Tetrachloroethene	127-18-4	25	0.01	0.06	0.01	0.03	0.01	0.03	0.00	0.02	0.00	0.04
Chlorobenzene	108-90-7	10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Ehtyl benzene	100-41-4	100	0.01	0.09	0.02	0.08	0.03	0.07	0.02	0.09	0.02	0.08
m- + p-Xylene	N/A	100	0.03	0.10	0.04	0.12	0.05	0.16	0.03	0.08	0.02	0.06
Styrene	100-42-5	50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
1,1,2,2-o-Xylene	79-34-5	1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	95-47-6	100	0.00	0.06	0.01	0.05	0.02	0.05	001	0.05	0.00	0.04

ppb = Parts per billion
ppm = Parts per million
nd = Not detected

N/A = Not available
TLV = ACGIH Threshold Limit Value
CAS # = Chemical Abstracts Service number

Environmental Surveillance Report

**TABLE G: VOLATILE ORGANIC COMPOUNDS IN AIR
FOURTH QUARTER 2000**

Compound	CAS #	TLV ppm	North site (X-1) (Daily averages)		Northeast site (X-2) (Daily averages)		Southeast site (X-3) (Daily averages)		South site (X-4) (Daily averages)		West site (X-5) (Daily averages)	
			Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb
Freon 134a	811-97-2		0.01	0.11	0.00	0.00	0.00	0.04	0.00	0.00	0.18	2.37
Freon 22	75-45-6	1000	0.02	0.21	0.02	0.13	0.01	0.10	0.00	0.02	0.01	0.14
Freon 12	75-71-8	1000	0.47	0.79	0.31	0.51	0.31	0.44	0.33	0.46	0.25	0.39
Chloromethane	74-87-3	50	0.21	2.39	0.11	1.06	0.11	0.61	0.05	0.19	0.08	0.47
Freon 114	76-14-2	1000	0.02	0.07	0.01	0.03	0.01	0.03	0.02	0.04	0.01	0.04
Vinyl chloride	75-01-4	5	0.00	0.00	0.00	0.02	0.00	0.03	0.003	0.32	0.00	0.03
1,3-Butadiene	106-99-0	2	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Chloroethane	75-00-3	100	0.00	0.00	0.00	0.00	0.00	0.07	0.00	0.00	0.00	0.00
Freon 123	306-83-2		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Freon 11	75-69-4	1000	0.10	0.18	0.09	0.15	0.11	0.18	0.09	0.14	0.06	0.12
Vinylidene chloride	75-35-4	5	0.02	0.08	0.02	0.04	0.02	0.05	0.03	0.06	0.02	0.05
Dichloromethane	75-09-2	50	0.06	0.26	0.09	0.45	0.10	0.28	0.07	0.17	0.04	0.14
Freon 113	76-13-1	1000	0.07	0.11	0.06	0.09	0.07	0.09	0.07	0.10	0.04	0.06
Methyl tert-butyl ether	1634-04-4	40	0.01	0.12	0.01	0.06	0.01	0.05	0.01	0.07	0.00	0.01
1,1-Dichloroethane	75-34-3	100	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

ppb = Parts per billion
ppm = Parts per million
nd = Not detected

N/A = Not available
TLV = ACGIH Threshold Limit Value
CAS # = Chemical Abstracts Service number

Environmental Surveillance Report

TABLE G: VOLATILE ORGANIC COMPOUNDS IN AIR (continued)

FOURTH QUARTER 2000

Compound	CAS #	TLV Ppm	North site (X-1) (Daily averages)		Northeast site (X-2) (Daily averages)		Southeast site (X-3) (Daily averages)		South site (X-4) (Daily averages)		West site (X-5) (Daily averages)	
			Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max ppb	Avg ppb	Max Ppb
Chloroform	67-66-3	10	0.01	0.07	0.01	0.07	0.01	0.06	0.01	0.08	0.01	0.08
1,2-Dichloroethane	107-06-2	10	0.00	0.01	0.01	0.04	0.01	0.03	0.01	0.04	0.00	0.02
1,1,1-Trichloroethane	71-55-6	350	0.06	0.15	0.04	0.08	0.04	0.07	0.05	0.10	0.04	0.09
Carbon tetrachloride	56-23-5	5	0.11	0.20	0.09	0.12	0.08	0.14	0.11	0.16	0.07	0.12
Benzene	71-43-2	0.1	0.24	0.60	0.30	0.79	0.34	0.84	0.28	0.59	0.14	0.31
Trichloroethene	79-01-6	50	0.00	0.03	0.01	0.02	0.01	0.02	0.01	0.02	0.00	0.01
1,1,2-Trichloroethane	79-00-5	10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Toluene	108-88-3	50	0.32	1.00	0.46	1.35	0.49	1.42	0.38	0.97	0.18	0.48
Tetrachloroethene	127-18-4	25	0.02	0.04	0.02	0.05	0.03	0.06	0.02	0.04	0.01	0.02
Chlorobenzene	108-90-7	10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Ehtyl benze ne	100-41-4	100	0.04	0.11	0.04	0.15	0.05	0.16	0.05	0.15	0.02	0.05
m- + p-Xylene	N/A	100	0.04	0.17	0.06	0.23	0.07	0.25	0.07	0.26	0.02	0.08
Styrene	100-42-5	50	0.00	0.02	0.01	0.04	0.02	0.04	0.01	0.05	0.01	0.05
1,1,2,2-o-Xylene	79-34-5	1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	95-47-6	100	0.03	0.13	0.04	0.16	0.05	0.18	0.05	0.15	0.02	0.06

ppb = Parts per billion
 ppm = Parts per million
 nd = Not detected

N/A = Not available
 TLV = ACGIH Threshold Limit Value
 CAS # = Chemical Abstracts Service number

Description of Precipitation and Surface Water Sampling Done This Quarter

Precipitation

Precipitation sampling was halted in March, 2001. No additional samples will be collected. This and other changes to the State's monitoring program will be presented at an upcoming Integrated Monitoring Plan (IMP) meeting

Surface Water

For surface water, sampling for the 1st quarter of 2001 was done as follows:

3 samples of the Sewage Treatment Plant Influent were collected, on 1/19/2001, 2/28/2001, and 3/21/2001

1 Sewage Treatment Plant Effluent sample was collected, on 2/28/2001;

1 pre-discharge sample was collected from Pond B-5 - on 2/21/2001;

1 sample was collected from Walnut Creek at Indiana Street, on 3/12/2001;

1 split sample from the RFET's sampler at GS03 was picked up on 1/31/2001;

1 round of nitrate sampling was done on 2/12/2001, at SW093, GS13, GS10, STP-Outfall, Pond A4, and Pond A5.

1 grab sample was collected from GS10 and analyzed only for radionuclides.

The results of these sampling events are shown in Table H (all but organic results) and Table I (organic results).

Notable Surface Water Results



During this quarter, there was only one analytical result that exceeded action levels or water quality stream standards. This was the silver result for the sampling done at Walnut Creek at Indiana Street station on March 12, 2001. The silver result for that sample was 1.3 ug/l, while the stream standard is 0.6 ug/l (as calculated for the existing Action Level Framework).

The laboratory was contacted, and quality assurance information indicates that the result is accurate. Since this was a grab sample, and the standard of 0.6 ug/l is a chronic standard, this result was not considered to be of immediate concern. Silver has not been routinely detected at a levels approaching or above the stream standard at this location. Still, this result does indicate that monitoring for silver at this location should be continued.



None of the other results for this quarter exceed water quality standards or are of immediate concern. Results for the most critical parameters - americium and plutonium, are presented along with historical values in the following graphs for selected stations monitored this quarter. Note that no Am or Pu analyses are performed by CDPHE for Indiana Street stations.

Nitrate results for stations SW093, GS13, and GS10, which are the most important to track, are also graphed. With respect to organic chemicals, Table I shows that one organic chemical was detected, but only at very low levels.



Graphs of Selected Surface Water Results

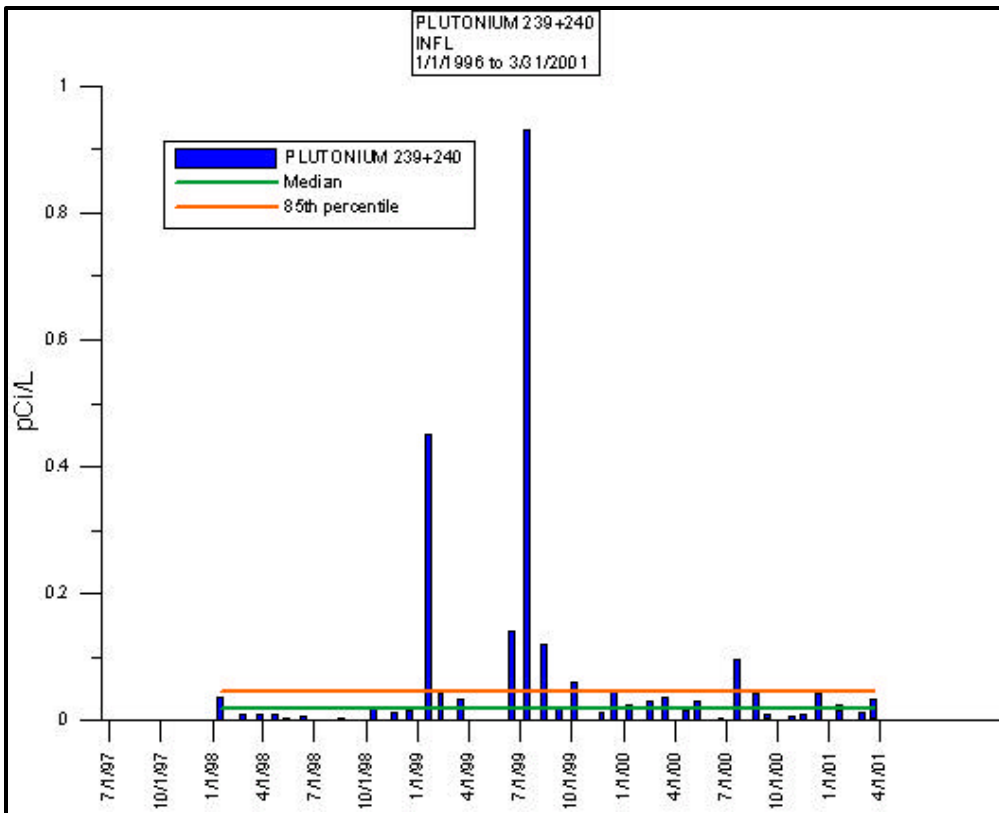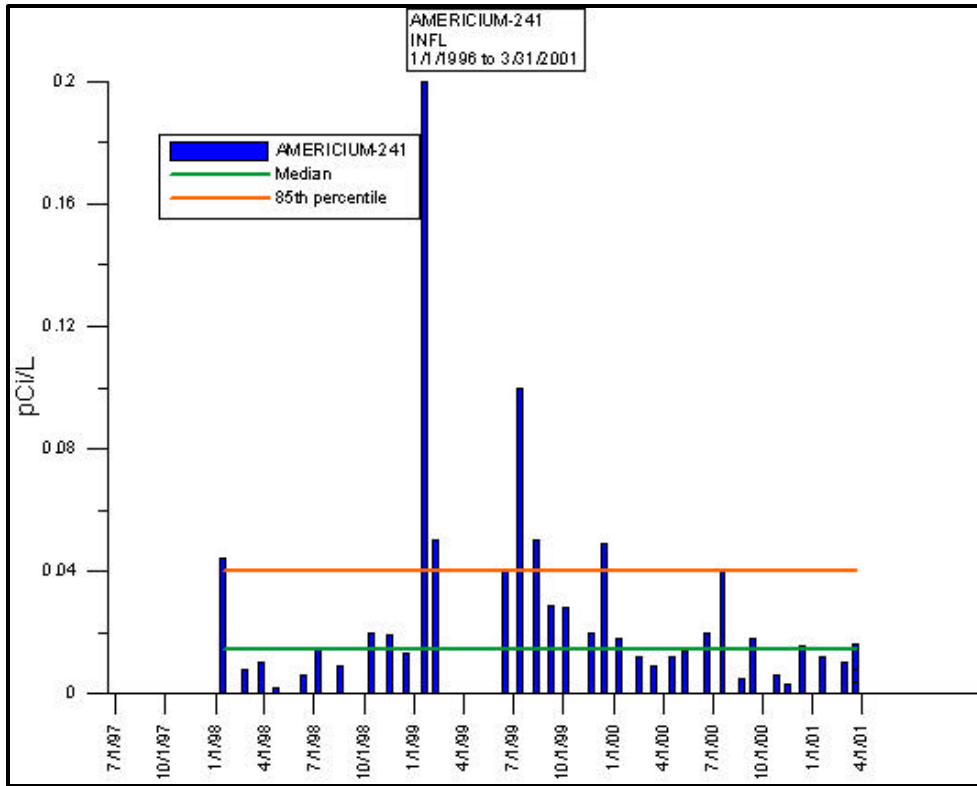

Figures SW1 and SW2 - Am and Pu Concentrations in STP Influent

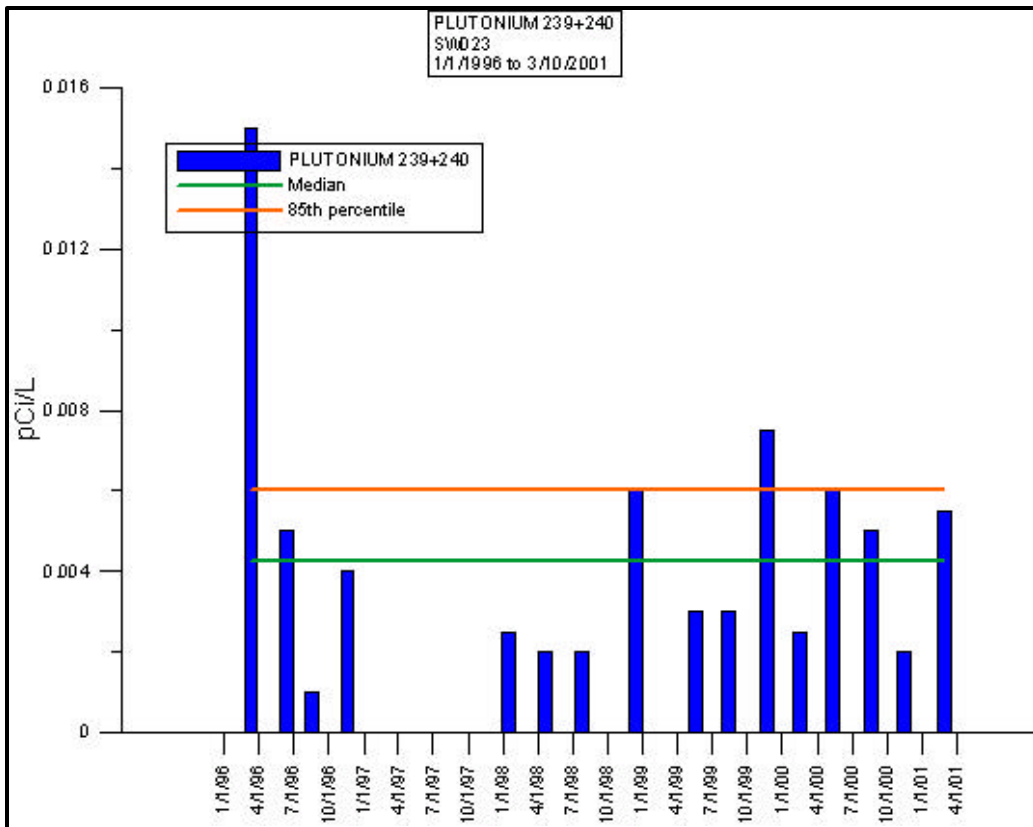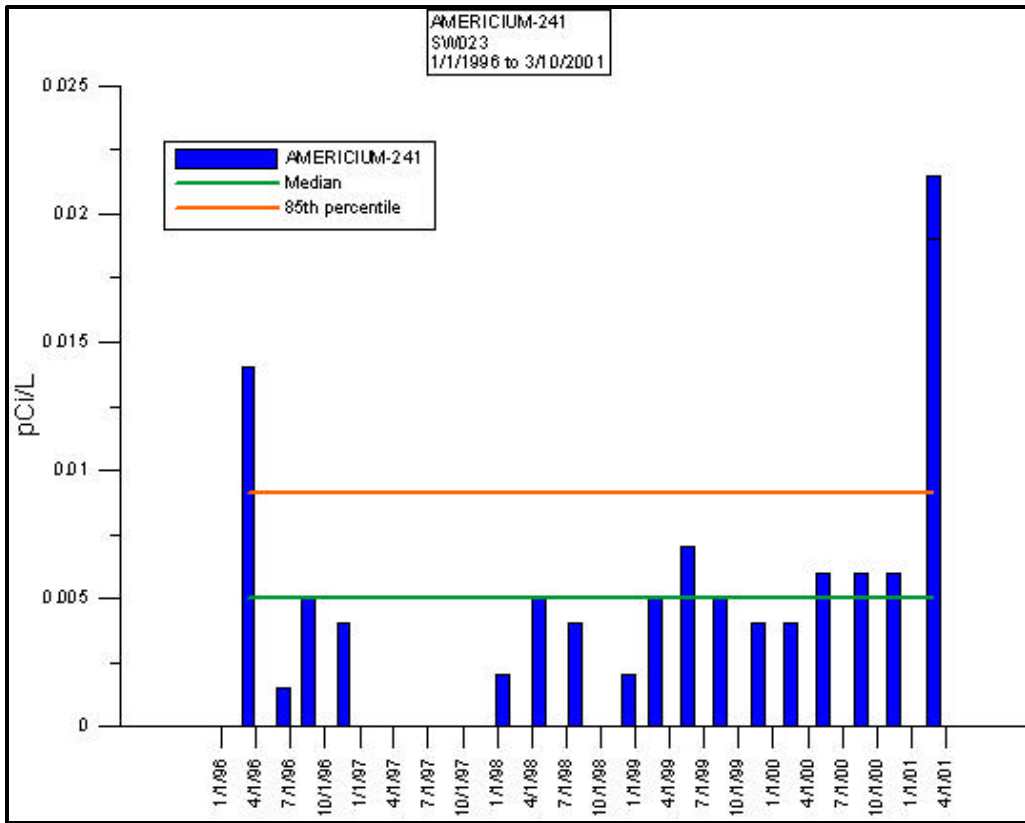

Figures SW3 and SW4 - Am and Pu Concentrations in STP Effluent

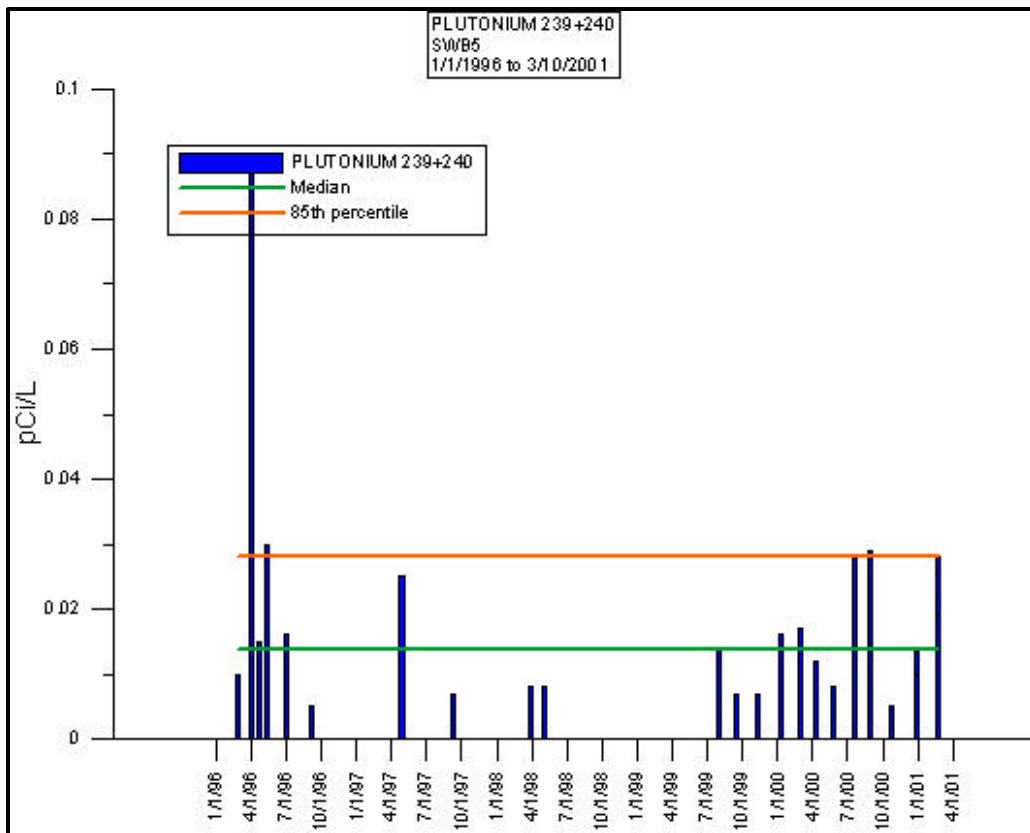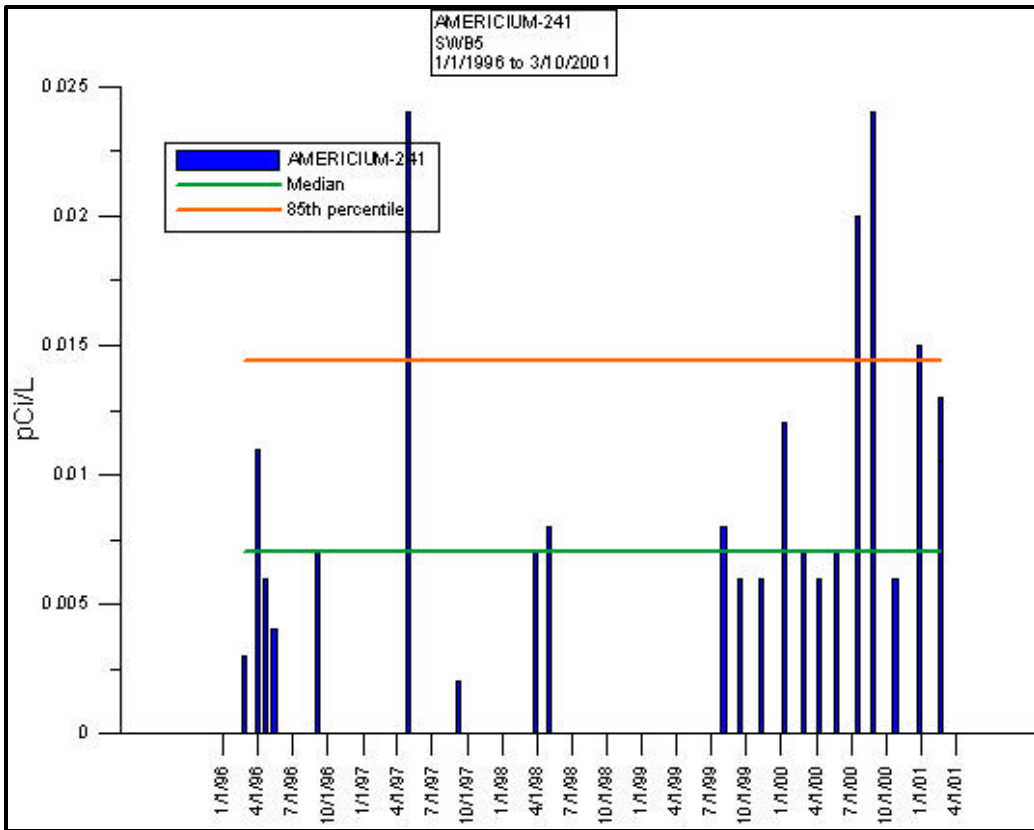

Figures SW5 and SW6 - Am and Pu Concentrations in Pond B5

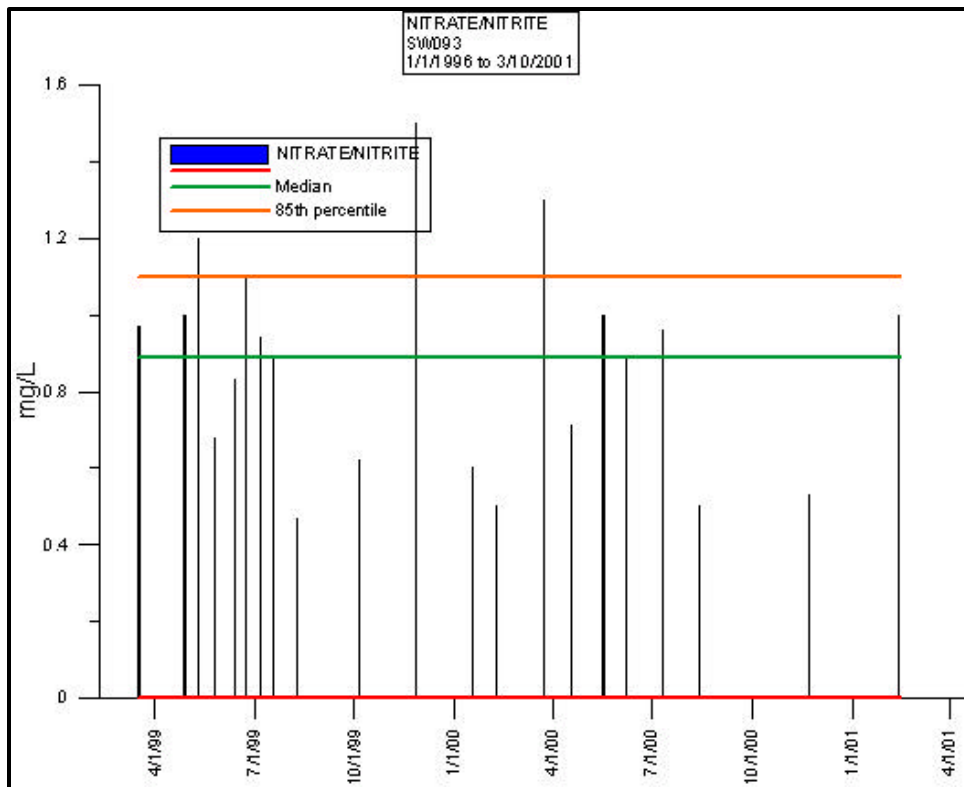


Figure SW7 – Nitrate Concentrations at SW093

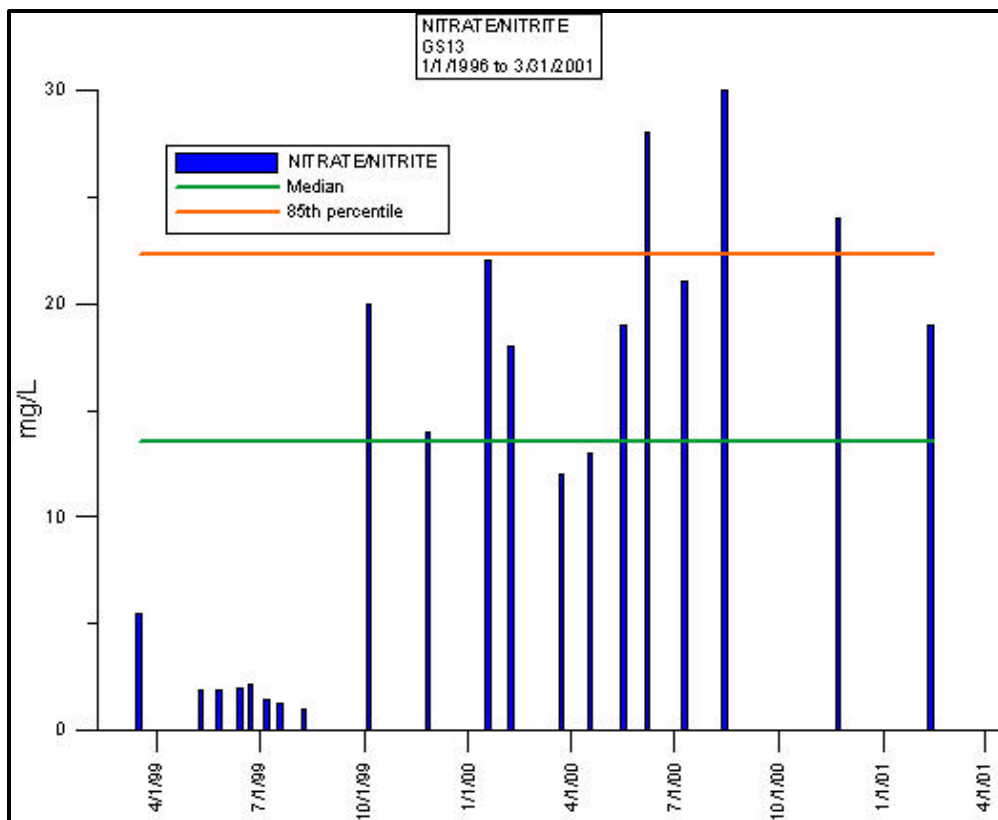


Figure SW8 – Nitrate Concentrations at GS13

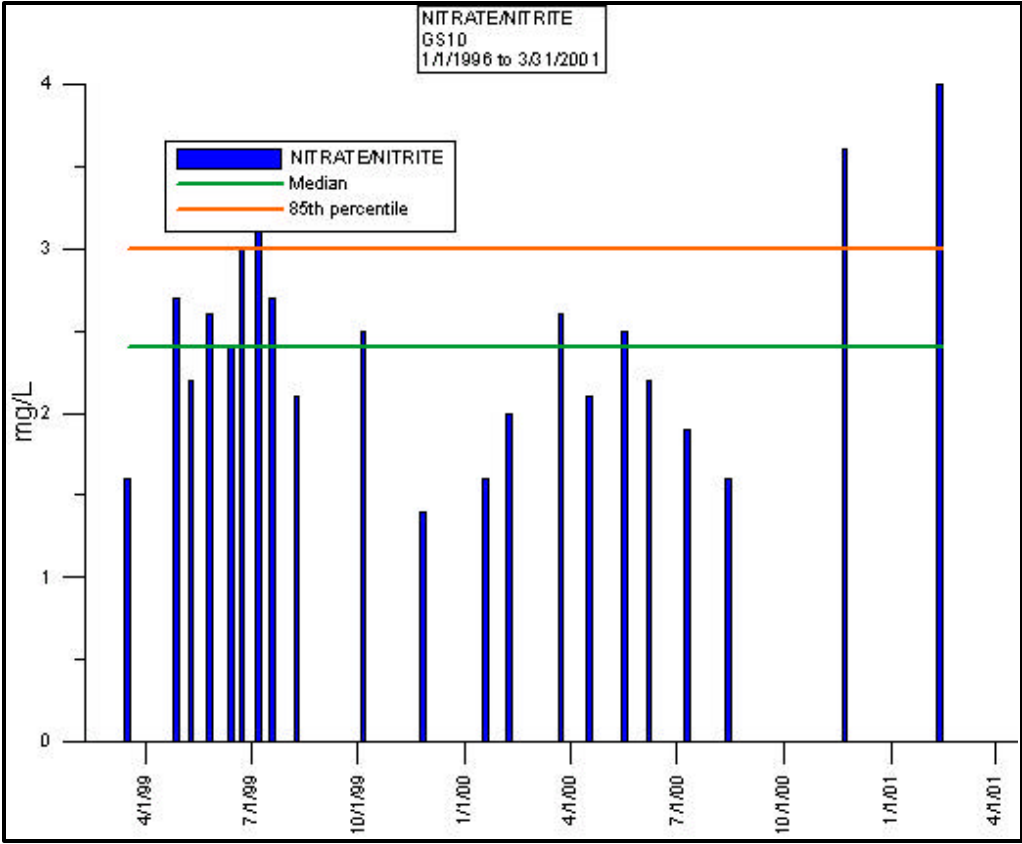


Figure SW9 – Nitrate Concentrations at GS10

Environmental Surveillance Report
TABLE H - INORGANIC ANALYSIS OF SURFACE WATER
FIRST QUARTER 2001

Location	Sample		Analysis Level			Units	*Analysis*			
	Date	Parameter					1st	2nd	3rd	
Influent to STP										
	1/19/2001									
		AMERICIUM-241, TOTAL	0.012	+/-	0.006	pCi/L				
		ARSENIC, TOTAL	<			ug/L				
		BERYLLIUM, TOTAL	<			ug/L				
		CADMIUM, TOTAL	<			ug/L				
		CHROMIUM, TOTAL	<			ug/L				
		COPPER, TOTAL	37			ug/L				
		GROSS ALPHA, TOTAL	<			pCi/L				
		GROSS BETA, TOTAL	20	+/-	6	pCi/L				
		IRON, TOTAL	450			ug/L				
		MANGANESE, TOTAL	31			ug/L				
		PH	7.6			SU				
		PLUTONIUM 239+240	<			pCi/L				
		SELENIUM, TOTAL	<			ug/L				
		SILVER, TOTAL	1.1			ug/L				
		SOLIDS, TOTAL SUSPENDED	110			mg/L				
		TEMPERATURE	12			C				
		TRITIUM, TOTAL	<			pCi/L				
		URANIUM, TOTAL	2			pCi/L				
	2/28/2001									
		AMERICIUM-241, TOTAL	0.01	+/-	0.005	pCi/L				
		ARSENIC, TOTAL	<			ug/L				
		BERYLLIUM, TOTAL	<			ug/L				
		CADMIUM, TOTAL	<			ug/L				
		CHROMIUM, TOTAL	<			ug/L				
		COPPER, TOTAL	26			ug/L				

Environmental Surveillance Report
TABLE H - INORGANIC ANALYSIS OF SURFACE WATER
FIRST QUARTER 2001

Location	Sample		Analysis			Units	*Analysis*		
	Date	Parameter	Level				1st	2nd	3rd
		GROSS ALPHA, TOTAL	<	8		pCi/L			
		GROSS BETA, TOTAL		18	+/-	6	pCi/L		
		IRON, TOTAL		330		ug/L			
		MANGANESE, TOTAL		32		ug/L			
		PH		7.5		SU			
		PLUTONIUM 239+240		0.012	+/-	0.006	pCi/L		
		SELENIUM, TOTAL		1		ug/L			
		SILVER, TOTAL		1.9		ug/L			
		SOLIDS, TOTAL SUSPENDED		15		mg/L			
		TEMPERATURE		11		C			
		TRITIUM, TOTAL	<	140		pCi/L			
		URANIUM, TOTAL	<	2		pCi/L			
	3/21/2001								
		AMERICIUM-241, TOTAL		0.008	+/-	0.004	pCi/L		
		ARSENIC, TOTAL	<	1		ug/L			
		BERYLLIUM, TOTAL	<	1		ug/L			
		CADMIUM, TOTAL	<	0.3		ug/L			
		CHROMIUM, TOTAL	<	3		ug/L			
		COPPER, TOTAL		26		ug/L			
		GROSS ALPHA, TOTAL		10	+/-	7	pCi/L		
		GROSS BETA, TOTAL		15	+/-	6	pCi/L		
		IRON, TOTAL		340		ug/L			
		MANGANESE, TOTAL		53		ug/L			
		PH		7.5		SU			
		PLUTONIUM 239+240		0.032	+/-	0.012	pCi/L		
		SELENIUM, TOTAL		1.1		ug/L			
		SILVER, TOTAL		1.2		ug/L			

Environmental Surveillance Report
TABLE H - INORGANIC ANALYSIS OF SURFACE WATER
FIRST QUARTER 2001

Location	Sample		Analysis	Units	*Analysis*		
	Date	Parameter			Level	1st	2nd
		SOLIDS, TOTAL SUSPENDED	92	mg/L			
		TEMPERATURE	13.7	C			
		TRITIUM, TOTAL	< 140	pCi/L			
		URANIUM, TOTAL	3	pCi/L			
WWTF EFFLUENT							
	2/12/2001						
		AMMONIA, TOTAL	4.1	mg/L			
		NITRATE/NITRITE	1.9	mg/L			
		PH	7.9	SU			
		TEMPERATURE	11.9	C			
	2/28/2001						
		AMERICIUM-241, TOTAL	< 0.013	pCi/L			
		GROSS ALPHA, TOTAL	< 8	pCi/L			
		GROSS BETA, TOTAL	11 +/-	5 pCi/L			
		PH	7.5	SU			
		PLUTONIUM 239+240	< 0.009	pCi/L			
		TEMPERATURE	11.7	C			
		TRITIUM, TOTAL	< 140	pCi/L			
		URANIUM, TOTAL	< 2	pCi/L			

Environmental Surveillance Report
TABLE H - INORGANIC ANALYSIS OF SURFACE WATER
FIRST QUARTER 2001

Location	Sample		Analysis	Level	Units	*Analysis*		
	Date	Parameter				1st	2nd	3rd
WALNUT CREEK AT IND.								
	1/31/2001	Split Sample From Auto-Sampler GS03						
		AMERICIUM-241, TOTAL	<	0.013	pCi/L			
		GROSS ALPHA, TOTAL	<	8	pCi/L			
		GROSS BETA, TOTAL		9	pCi/L	+/-	5	
		PLUTONIUM 239+240		0.018	pCi/L	+/-	0.006	
		TRITIUM, TOTAL	<	140	pCi/L			
		URANIUM, TOTAL	<	2	pCi/L			
	3/12/2001	AMMONIA, TOTAL	<	0.05	mg/L			
		BERYLLIUM, DISSOLVED	<	1	ug/L			
		CADMIUM, DISSOLVED	<	0.3	ug/L			
		CHLORIDE		130	mg/L			
		CHROMIUM, TOTAL	<	3	ug/L			
		CONDUCTIVITY, SPECIFIC		770	umho			
		NITRATE/NITRITE	<	0.05	mg/L			
		NITRITE		0.01	mg/L			
		PH		8.34	SU			
		PHOSPHATE, ORTHO		0.13	mg/L			
		PHOSPHATE, TOTAL		0.25	mg/L			
		SILVER, DISSOLVED		1.3	ug/L			
		SOLIDS, DISSOLVED		430	mg/L			
		SOLIDS, TOTAL SUSPENDED		90	mg/L			
		TEMPERATURE		5.9	C			

Environmental Surveillance Report
TABLE H - INORGANIC ANALYSIS OF SURFACE WATER
FIRST QUARTER 2001

Location	Sample		Analysis Level	Units	*Analysis*		
	Date	Parameter			1st	2nd	3rd
POND A4							
	2/12/2001						
		AMMONIA, TOTAL	0.16	mg/L			
		NITRATE/NITRITE	0.14	mg/L			
		PH	7.24	SU			
		TEMPERATURE	2.2	C			
POND B5							
	2/12/2001						
		AMMONIA, TOTAL	3.2	mg/L			
		NITRATE/NITRITE	2.6	mg/L			
		PH	7.55	SU			
		TEMPERATURE	2.6	C			
	2/21/2001						
		AMERICIUM-241, TOTAL	0.005	+/- 0.003	pCi/L		
		AMMONIA, TOTAL	3.4		mg/L		
		ARSENIC, TOTAL	2		ug/L		
		BERYLLIUM, DISSOLVED	<	1	ug/L		
		CADMIUM, DISSOLVED	<	0.3	ug/L		
		CHLORIDE		180	mg/L		
		CHROMIUM, TOTAL	<	3	ug/L		
		CONDUCTIVITY, SPECIFIC		950	umho		
		COPPER, DISSOLVED	<	4	ug/L		
		CYANIDE, DISTILLED	<	0.01	mg/L		
		GROSS ALPHA, TOTAL	<	8	pCi/L		

Environmental Surveillance Report
TABLE H - INORGANIC ANALYSIS OF SURFACE WATER
FIRST QUARTER 2001

Location	Sample		Analysis			Units	*Analysis*		
	Date	Parameter	Level				1st	2nd	3rd
		GROSS BETA, TOTAL	12	+/-	5	pCi/L			
		IRON, RECOVERABLE	85			ug/L			
		MANGANESE, RECOVERABLE	83			ug/L			
		NITRATE/NITRITE	2.5			mg/L			
		NITRITE	0.27			mg/L			
		PH	9			SU			
		PHOSPHATE, ORTHO	1.8			mg/L			
		PHOSPHATE, TOTAL	2			mg/L			
		PLUTONIUM 239+240	0.028	+/-	0.006	pCi/L			
		SELENIUM, DISSOLVED	1.2			ug/L			
		SILVER, DISSOLVED	<			ug/L			
		SOLIDS, DISSOLVED	220			mg/L			
		SOLIDS, TOTAL SUSPENDED	12			mg/L			
		SULFATE	26			mg/L			
		TEMPERATURE	7.8			C			
		TRITIUM, TOTAL	<			pCi/L			
		URANIUM, TOTAL	<			pCi/L			
SW093	2/12/2001	AMMONIA, TOTAL	0.29			mg/L			
		NITRATE/NITRITE	1			mg/L			
		PH	7.56			SU			
		TEMPERATURE	3.3			C			

Environmental Surveillance Report
TABLE H - INORGANIC ANALYSIS OF SURFACE WATER
FIRST QUARTER 2001

Location	Sample		Analysis Level	Units	*Analysis*		
	Date	Parameter			1st	2nd	3rd
GS13	2/12/2001	AMMONIA, TOTAL	0.27	mg/L			
		NITRATE/NITRITE	19	mg/L			
		PH	7.07	SU			
		TEMPERATURE	0.7	C			
GS10	2/12/2001	AMMONIA, TOTAL	1.2	mg/L			
		NITRATE/NITRITE	4	mg/L			
		PH	7.89	SU			
		TEMPERATURE	3.9	C			

5/22/2001 Run Date

Environmental Surveillance Report
TABLE I - ORGANIC ANALYSIS OF SURFACE WATER
FIRST QUARTER 2001

Location	Date	Method	Result	**Qualifiers**		
				1st	2nd	3rd
	2/21/2001	Volatile Organic Compounds	CHLOROFORM	0.6	ug/l	

Results Show Detects Only

B = found in blank

J = detected, but below Practical Quantitative Limit (value is estimated)

5/22/2001 Run Date

GLOSSARY

Am	Americium
APCD	Air Pollution Control Division
AQCC	Air quality control commission
B	Found in blank
Be	Beryllium
CAS	Chemical abstracts service number
CDPHE	Colorado Department of Public Health and Environment
EPA	Environmental Protection Agency
H	Exceeds holding time
J	Detected but below practical quantitative limit
LARS	Laboratory and Radiation Services
MCL	Maximum contaminant level (below MCL is safe)
MDL	Minimum detection level
Nd	Not detected
pCi/l	Picocuries per liter
PM	Particulate material
ppb	Parts per billion
ppm	Parts per million
PQL	Practical quantitative level
Pu	Plutonium
QNS	Quantity not sufficient
RFETS	Rocky Flats Environmental Technology Site
RFPU	Rocky Flats Program Unit
SVOC	Semivolatile organic compounds
TLV	ACGIH Threshold limit value
TSP	Total Suspended Particulate
TSS	Total suspended solids
ug/m ³	Micrograms per cubic meter
U	Uranium
VOCs	Volatile organic compounds
WQCC	Water Quality Control Commission
WQCD	Water Quality Control Division